

APPENDIX A – 2012 Ocean Plan

**WATER QUALITY CONTROL PLAN
OCEAN WATERS OF CALIFORNIA**



2012

**STATE WATER RESOURCES CONTROL BOARD
CALIFORNIA ENVIRONMENTAL PROTECTION AGENCY**



State of California

Edmund G. Brown Jr. Governor

California Environmental Protection Agency

Matthew Rodriquez, Secretary

State Water Resources Control Board

1001 I Street

Sacramento, CA 95814

(916) 341-5250

Homepage: <http://www.waterboards.ca.gov>

Charles R. Hoppin, Chairman

Frances Spivy-Weber, Vice Chair

Tam M. Doduc, Member

Steven Moore, Member

Felicia Marcus, Member

Tom Howard, Executive Director

Jonathan Bishop, Chief Deputy Director

Caren Trgovcich, Chief Deputy Director

Cover Art by:

Ivy Liao, 10th Grade, 2012

California Coastal Art & Poetry Contest


California Coastal Commission

www.coast4u.org

Title Page Drawing by:

Zev Labinger, 1997

State of California
STATE WATER RESOURCES CONTROL BOARD

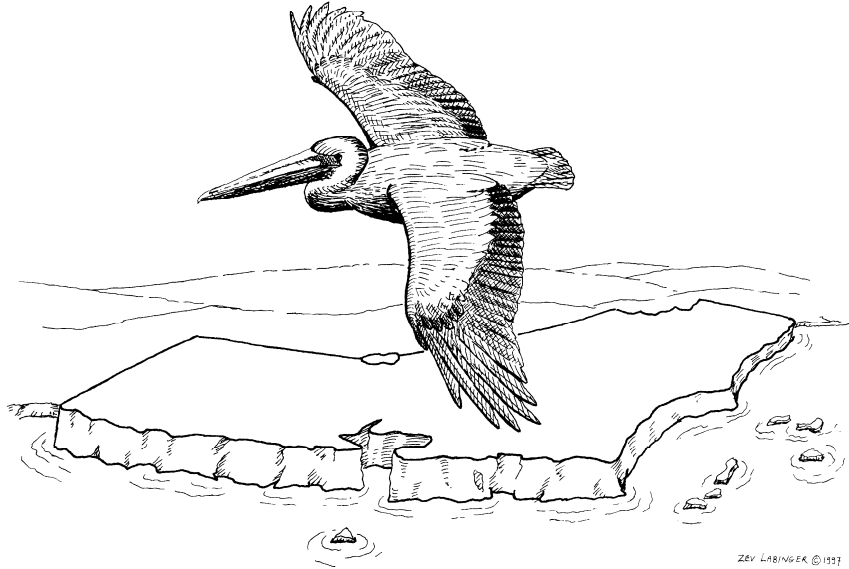

2012

CALIFORNIA OCEAN PLAN

WATER QUALITY CONTROL PLAN

OCEAN WATERS OF CALIFORNIA

Effective **XXXXXXX**

Adopted October 16, 2012

Approved by the Office of Administrative Law on **XXXXXXX**

**STATE WATER RESOURCES CONTROL BOARD
RESOLUTION NO. 2012-0056**

**ADOPTING THE CALIFORNIA OCEAN PLAN AMENDMENT IMPLEMENTING STATE
WATER BOARD RESOLUTIONS 2010-0057 AND 2011-0013
REGARDING STATE WATER QUALITY PROTECTION AREAS AND MARINE
PROTECTED AREAS**

WHEREAS:

1. The State Water Resources Control Board (State Water Board) adopted the California Ocean Plan (Ocean Plan) in 1972 and revised it in 1978, 1983, 1988, 1990, 1997, 2001, 2005 and 2009.
2. The State Water Board is responsible for reviewing Ocean Plan water quality standards and for modifying and adopting standards in accordance with Section 303 (c)(1) of the federal Clean Water Act and section 13170.2(b) of the California Water Code.
3. On November 16, 2010, the State Water Board adopted [Resolution No. 2010–0057](#), Marine Protected Areas and State Water Quality Protection Areas. The Resolution directed State Water Board staff to propose amendments to the Ocean Plan to address designation of new State Water Quality Protection Areas and to clarify requirements for existing discharges relative to Marine Protected Areas.
4. On March 15, 2011, the State Water Board adopted the Triennial Review Workplan 2011-2013, in [Resolution No. 2011– 0013](#), which included under Issue 1 direction to staff to propose an amendment to the Ocean Plan addressing State Water Quality Protection Areas and Marine Protected Areas.
5. On July 8, 2011, the State Water Board held a scoping meeting regarding potential Ocean Plan Amendments to solicit input from public agencies and members of the public on the scope and content of the substitute environmental documentation to be prepared in support of the amendment.
6. On May 1, 2012, the State Water Board conducted a public hearing. Twenty- four written public comments were received and reviewed. Staff considered comments and input from Board Members and the public and drafted revisions to the proposed amendments and draft SED, which were circulated on February 28, 2012.
7. On August 22, 2012, the State Water Board conducted a public workshop to consider changes proposed by staff in response to comments received. A written comment period from July 31, 2012 through August 31, 2012, allowed for submission of comments on the changes from the earlier draft documents.

8. The Ocean Plan is clear that there shall not be degradation of marine communities or other exceedances of water quality objectives due to waste discharges. This is true for all near coastal ocean waters, regardless of whether a Marine Protected Area is present. If sound scientific information becomes available demonstrating that discharges are causing or contributing to the degradation of marine communities, or causing or contributing to the exceedance of narrative or numeric water quality objectives, then new or modified limitations or conditions may be placed in the NPDES permit to provide protections for marine life, both inside and outside of Marine Protected Areas.
9. The State Water Board prepared and circulated a draft Substitute Environmental Document (SED) in accordance with the provisions of the California Environmental Quality Act and title 14, California Code of Regulations section 15251(g) and in compliance with State Water Board regulations governing certified regulatory programs. (See Cal. Code Regs., tit. 23, § 3777) The SED consists of the draft SED dated January 6, 2012, and updated on February 23 and July 25, 2012, and responses to comments on the draft SED and the proposed project. Together, these documents constitute the required environmental documentation under CEQA. (See Cal. Code Regs., tit. 14, §§ 15250, 15252; Cal. Code of Regs., tit. 23, § 3777.)
10. The State Water Board has considered the SED, which analyzes the project, alternatives to the project and reasonably foreseeable methods of compliance with the proposed amendments and concludes that the project will not result in adverse environmental impacts.
11. These amendments to the Ocean Plan do not become effective until approved by the Office of Administrative Law (OAL).

THEREFORE BE IT RESOLVED THAT:

The State Water Board:

1. After considering the entire record, including oral comments at the public hearing, adopts the State Water Quality Protection Areas and Marine Protected Areas amendment to the Ocean Plan.
2. Approves the [final SED](#), which includes the responses to comments, and directs the Executive Director or designee to transmit the Notice of Decision to the Secretary of Resources.
3. Authorizes the Executive Director or designee to submit the amended Ocean Plan to OAL for review and approval.
4. Directs the Executive Director or designee to make minor, non-substantive modifications to the language of the amendment, if OAL determines during its

approval process that such changes are needed, and inform the State Water Board of any such changes.

CERTIFICATION

The undersigned Clerk to the Board does hereby certify that the foregoing is a full, true, and correct copy of a resolution duly and regularly adopted at a meeting of the State Water Resources Control Board held on October 16, 2012.

AYE: Chairman Charles R. Hoppin
Vice Chair Frances Spivy-Weber
Board Member Tam M. Doduc
Board Member Steven Moore
Board Member Felicia Marcus

NAY: None

ABSENT: None

ABSTAIN: None



Jeanine Townsend
Clerk to the Board

**STATE WATER RESOURCES CONTROL
BOARD RESOLUTION NO. 2012-0057**

**ADOPTION OF THE CALIFORNIA OCEAN PLAN AMENDMENTS
REGARDING MODEL MONITORING, VESSEL DISCHARGES, AND NON-
SUBSTANTIVE CHANGES**

WHEREAS:

1. The State Water Resources Control Board (State Water Board) adopted the California Ocean Plan (Ocean Plan) in 1972 and revised it in 1978, 1983, 1988, 1990, 1997, 2001, 2005 and 2009.
2. The State Water Board is responsible for reviewing Ocean Plan water quality standards and for modifying and adopting standards in accordance with Section 303 (c)(1) of the federal Clean Water Act and section 13170.2(b) of the California Water Code.
3. On August 1, 8, and 15, of 2006, the State Water Board conducted public scoping meetings in Santa Rosa, Los Angeles, and Monterey respectively to receive public comments for potential revisions to the Ocean Plan.
4. On June 26, 2007, the State Water Board held a public scoping meeting in San Francisco regarding potential Ocean Plan Amendments and solicited public comments on the scope and content of the environmental information that the State Water Board must consider.
5. On March 15, 2011, the State Water Board adopted the Ocean Plan Triennial Review Work Plan for 2011-2013 by [Resolution 2011-0013](#). The work plan identifies issues for which further action is needed, including model monitoring, vessel discharges, and non- substantive changes, which are addressed by the proposed amendments to the Ocean Plan.
6. On November 1, 2011, the State Water Board conducted a public hearing for the proposed amendments to the Ocean Plan. Public comments were received and reviewed, and staff developed edits based on these comments.
7. On August 22, 2012, the State Water Board conducted a public workshop, where the State Water Board solicited comments on staff edits to the proposed amendments to the Ocean Plan related to model monitoring, vessel discharges and non-substantive changes.
8. The State Water Board prepared and circulated a draft Substitute Environmental Document (SED) in accordance with the provisions of the California Environmental Quality Act and title 14, California Code of Regulations section 15251(g) and in compliance with State Water Board regulations governing certified regulatory

programs. (See Cal. Code Regs., tit. 23, § 3777) The SED consists of the draft SED dated January 6, 2012, and updated on February 23 and July 25, 2012, and responses to comments on the draft SED and the proposed project. Together, these documents constitute the required environmental documentation under CEQA. (See Cal. Code Regs., tit. 14, §§ 15250, 15252; Cal. Code of Regs., tit. 23, § 3777.)

9. The State Water Board has considered the SED, which analyzes the project, alternative to the project and reasonably foreseeable methods of compliance with the proposed amendments and concludes that the project will not result in adverse environmental impacts.
10. These amendments to the Ocean Plan do not become affective until approved by the Office of Administrative Law (OAL).

THEREFORE BE IT RESOLVED THAT:

The State Water Board:

1. After considering the entire record, including oral comments at the public hearing, adopts the proposed amendments to the Ocean Plan regarding model monitoring, vessel discharges and non-substantive administrative changes.
2. Approve the [final SED](#), which includes the response to comments and directs the Executive Director or designee to transmit the Notice of Decision to the Secretary of Resources.
3. Authorizes the Executive Director or designee to submit the amended Ocean Plan to OAL for review and approval.
4. Directs the Executive Director or designee to make minor, non-substantive modifications to the language of the Policy, if during the OAL approval process, OAL determines that such changes are needed for clarity or consistency, and inform the State Water Board of any changes.

CERTIFICATION

The undersigned Clerk to the Board does hereby certify that the foregoing is a full, true, and correct copy of a resolution duly and regularly adopted at a meeting of the State Water Resources Control Board held on October 16, 2012.

AYE: Chairman Charles R. Hoppin
Vice Chair Frances Spivy-Weber
Board Member Tam M. Doduc
Board Member Steven Moore
Board Member Felicia Marcus

NAY: None

ABSENT: None

ABSTAIN: None



Jeanine Townsend
Clerk to the Board

CALIFORNIA OCEAN PLAN

TABLE OF CONTENTS

INTRODUCTION

A. Purpose and Authority.....	1
B. Principles	1
C. Applicability	1

I. BENEFICIAL USES

A. Identification of Beneficial Uses	3
--	---

II. WATER QUALITY OBJECTIVES

A. General Provisions	4
B. Bacterial Characteristics	4
C. Physical Characteristics	5
D. Chemical Characteristics.....	6
E. Biological Characteristics	10
F. Radioactivity.....	10

III. PROGRAM OF IMPLEMENTATION

A. General Provisions	11
B. Table 2 Effluent Limitations.....	12
C. Implementation Provisions for Table 1	13
D. Implementation Provisions for Bacterial Characteristics	20
E. Implementation Provisions for Marine Managed Areas	21
F. Revision of Waste Discharge Requirements	24
G. Compliance Schedules in National Pollutant Discharge Elimination System (NPDES) Permits	25
H. Monitoring Program	25
I. Discharge Prohibitions	26
J. State Board Exceptions to Plan Requirements.....	27
K. Implementation Provisions for Vessel Discharges	27

APPENDICES

Appendix I: Definition of Terms.....	28
Appendix II: Minimum* Levels.....	34
Appendix III: Standard Monitoring Procedures	39
Appendix IV: Procedures for the Nomination and Designation of State Water Quality Protection Areas	54
Appendix V: State Water Quality Protection Areas, Areas of Special Biological Significance	57
Appendix VI: Reasonable Potential Analysis Procedure for Determining Which Table 1	

Objectives Require Effluent Limitations.....	59
Appendix VII: Exceptions to the California Ocean Plan.....	63
Appendix VIII: Maps of the Ocean, Coast, and Islands	64

LIST OF TABLES

Table 1	Water Quality Objectives	7 to 10
Table 2	Effluent Limitations	12
Table 3	Background Seawater Concentrations.....	14
Table 4	Conservative Estimates of Chronic Toxicity.....	25
Appendix II		
Table II-1	Minimum* Levels – Volatile Chemicals.....	34
Table II-2	Minimum* Levels – Semi Volatile Chemicals.....	35 to 36
Table II-3	Minimum* Levels – Inorganics	37
Table II-4	Minimum* Levels – Pesticides and PCBs.....	38
Appendix III		
Table III-1	Approved Tests - Chronic Toxicity (TUc)	52
Appendix V		
Table V-1	State Water Quality Protection Areas, Areas of Special Biological Significance	57 to 58
Appendix VI		
Table VI-1	Tolerance factors $g'_{(.95,.95,n)}$ for calculating normal distribution one-sided upper 95 percent tolerance bounds for the 95 th percentile.....	61
Appendix VII		
Table VII-1	Exceptions to the Ocean Plan.....	63

LIST OF FIGURES

Appendix VI		
Figure VI-1	Reasonable potential analysis flow chart.....	62
Appendix VIII		
Figure VIII-1	Map of ASBS Boundaries, MPA Boundaries, Wastewater Outfall Points, Marine Sanctuary Boundaries, and Enclosed Bays in northern Region 1.....	64
Figure VIII-2	Map of ASBS Boundaries, MPA Boundaries, Wastewater Outfall Points, Marine Sanctuary Boundaries, and Enclosed Bays in southern Region 1 and Region 2	65
Figure VIII-3	Map of ASBS Boundaries, MPA Boundaries, Wastewater Outfall Points,	

	Marine Sanctuary Boundaries, and Enclosed Bays in northern Region 3.....	66
Figure VIII-4	Map of ASBS Boundaries, MPA Boundaries, Wastewater Outfall Points, Marine Sanctuary Boundaries, and Enclosed Bays in southern Region 3 and northern Channel Islands	67
Figure VIII-5	Map of ASBS Boundaries, MPA Boundaries, Wastewater Outfall Points, Marine Sanctuary Boundaries, and Enclosed Bays in southern Channel Islands and Regions 4, 8 and 9.....	68

CALIFORNIA OCEAN PLAN
WATER QUALITY CONTROL PLAN FOR
OCEAN WATERS OF CALIFORNIA

INTRODUCTION

A. Purpose and Authority

1. In furtherance of legislative policy set forth in Section 13000 of Division 7 of the California Water Code (CWC) (Stats. 1969, Chap. 482) pursuant to the authority contained in Section 13170 and 13170.2 (Stats. 1971, Chap. 1288) the State Water Resources Control Board (State Water Board) hereby finds and declares that protection of the quality of the ocean* waters for use and enjoyment by the people of the State requires control of the discharge of waste* to ocean* waters in accordance with the provisions contained herein. The Board finds further that this plan shall be reviewed at least every three years to guarantee that the current standards are adequate and are not allowing degradation* to marine species or posing a threat to public health.

B. Principles

1. Harmony Among Water Quality Control Plans and Policies.
 - a. In the adoption and amendment of water quality control plans, it is the intent of this Board that each plan will provide for the attainment and maintenance of the water quality standards of downstream waters.
 - b. To the extent there is a conflict between a provision of this plan and a provision of another statewide plan or policy, or a regional water quality control plan (basin plan), the more stringent provision shall apply except where pursuant to Chap. III.J of this Plan, the State Water Board has approved an exception to the Plan requirements.

C. Applicability

1. This plan is applicable, in its entirety, to point source discharges to the ocean*. Nonpoint sources of waste* discharges to the ocean* are subject to Chapter I Beneficial Uses, Chapter II - WATER QUALITY OBJECTIVES (wherein compliance with water quality objectives shall, in all cases, be determined by direct measurements in the receiving waters*) and Chapter III - PROGRAM OF IMPLEMENTATION Parts A.2, D, E, and I.
2. This plan is not applicable to discharges to enclosed* bays and estuaries* or inland waters or the control of dredged* material.

* See Appendix I for definition of terms.

3. Provisions regulating the thermal aspects of waste* discharged to the ocean* are set forth in the Water Quality Control Plan for the Control of Temperature in the Coastal and Interstate Waters and Enclosed* Bays and Estuaries* of California.
4. Within this Plan, references to the State Board or State Water Board shall mean the State Water Resources Control Board. References to a Regional Board or Regional Water Board shall mean a California Regional Water Quality Control Board. References to the Environmental Protection Agency, USEPA, or EPA shall mean the federal Environmental Protection Agency.

* See Appendix I for definition of terms.

I. BENEFICIAL USES

- A. The beneficial uses of the ocean* waters of the State that shall be protected include industrial water supply; water contact and non-contact recreation, including aesthetic enjoyment; navigation; commercial and sport fishing; mariculture*; preservation and enhancement of designated Areas* of Special Biological Significance (ASBS); rare and endangered species; marine habitat; fish migration; fish spawning and shellfish* harvesting.

* See Appendix I for definition of terms.

II. WATER QUALITY OBJECTIVES

A. General Provisions

1. This chapter sets forth limits or levels of water quality characteristics for ocean* waters to ensure the reasonable protection of beneficial uses and the prevention of nuisance. The discharge of waste* shall not cause violation of these objectives.
2. The Water Quality Objectives and Effluent Limitations are defined by a statistical distribution when appropriate. This method recognizes the normally occurring variations in treatment efficiency and sampling and analytical techniques and does not condone poor operating practices.
3. Compliance with the water quality objectives of this chapter shall be determined from samples collected at stations representative of the area within the waste field where initial* dilution is completed.

B. Bacterial Characteristics

1. Water-Contact Standards

Both the State Water Board and the California Department of Public Health (CDPH) have established standards to protect water contact recreation in coastal waters from bacterial contamination. Subsection a of this section contains bacterial objectives adopted by the State Water Board for ocean waters used for water contact recreation. Subsection b describes the bacteriological standards adopted by CDPH for coastal waters adjacent to public beaches and public water contact sports areas in ocean waters.

a. State Water Board Water-Contact Standards

- (1) Within a zone bounded by the shoreline and a distance of 1,000 feet from the shoreline or the 30-foot depth contour, whichever is further from the shoreline, and in areas outside this zone used for water contact sports, as determined by the Regional Board (i.e., waters designated as REC-1), but including all kelp* beds, the following bacterial objectives shall be maintained throughout the water column:

30-day Geometric Mean – The following standards are based on the geometric mean of the five most recent samples from each site:

- i. Total coliform density shall not exceed 1,000 per 100 mL;
- ii. Fecal coliform density shall not exceed 200 per 100 mL; and
- iii. Enterococcus density shall not exceed 35 per 100 mL.

Single Sample Maximum:

- i. Total coliform density shall not exceed 10,000 per 100 mL;
- ii. Fecal coliform density shall not exceed 400 per 100 mL;

* See Appendix I for definition of terms.

- iii. Enterococcus density shall not exceed 104 per 100 mL; and
- iv. Total coliform density shall not exceed 1,000 per 100 mL when the fecal coliform/total coliform ratio exceeds 0.1.

- (2) The "Initial* Dilution Zone" of wastewater outfalls shall be excluded from designation as "kelp* beds" for purposes of bacterial standards, and Regional Boards should recommend extension of such exclusion zone where warranted to the State Water Board (for consideration under Chapter III. J.). Adventitious assemblages of kelp plants on waste discharge structures (e.g., outfall pipes and diffusers) do not constitute kelp* beds for purposes of bacterial standards.

b. CDPH Standards

CDPH has established minimum protective bacteriological standards for coastal waters adjacent to public beaches and for public water-contact sports areas in ocean waters. These standards are found in the California Code of Regulations, title 17, section 7958, and they are identical to the objectives contained in subsection a. above. When a public beach or public water-contact sports area fails to meet these standards, CDPH or the local public health officer may post with warning signs or otherwise restrict use of the public beach or public water-contact sports area until the standards are met. The CDPH regulations impose more frequent monitoring and more stringent posting and closure requirements on certain high-use public beaches that are located adjacent to a storm drain that flows in the summer.

For beaches not covered under AB 411 regulations, CDPH imposes the same standards as contained in Title 17 and requires weekly sampling but allows the county health officer more discretion in making posting and closure decisions.

2. Shellfish* Harvesting Standards

- a. At all areas where shellfish* may be harvested for human consumption, as determined by the Regional Board, the following bacterial objectives shall be maintained throughout the water column:

- (1) The median total coliform density shall not exceed 70 per 100 mL, and not more than 10 percent of the samples shall exceed 230 per 100 mL.

C. Physical Characteristics

- 1. Floating particulates and grease and oil shall not be visible.
- 2. The discharge of waste* shall not cause aesthetically undesirable discoloration of the ocean* surface.
- 3. Natural* light shall not be significantly* reduced at any point outside the initial* dilution zone as the result of the discharge of waste*.

* See Appendix I for definition of terms.

4. The rate of deposition of inert solids and the characteristics of inert solids in ocean* sediments shall not be changed such that benthic communities are degraded*.

D. Chemical Characteristics

1. The dissolved oxygen concentration shall not at any time be depressed more than 10 percent from that which occurs naturally, as the result of the discharge of oxygen demanding waste* materials.
2. The pH shall not be changed at any time more than 0.2 units from that which occurs naturally.
3. The dissolved sulfide concentration of waters in and near sediments shall not be significantly* increased above that present under natural conditions.
4. The concentration of substances set forth in Chapter II, Table 1, in marine sediments shall not be increased to levels which would degrade* indigenous biota.
5. The concentration of organic materials in marine sediments shall not be increased to levels that would degrade* marine life.
6. Nutrient materials shall not cause objectionable aquatic growths or degrade* indigenous biota.
7. Numerical Water Quality Objectives
 - a. Table 1 water quality objectives apply to all discharges within the jurisdiction of this Plan. Unless otherwise specified, all metal concentrations are expressed as total recoverable concentrations.
 - b. Table 1 Water Quality Objectives

* See Appendix I for definition of terms.

**TABLE 1 (formerly TABLE B)
WATER QUALITY OBJECTIVES**

		Limiting Concentrations		
	Units of Measurement	6-Month Median	Daily Maximum	Instantaneous Maximum
OBJECTIVES FOR PROTECTION OF MARINE AQUATIC LIFE				
Arsenic	µg/L	8.	32.	80.
Cadmium	µg/L	1.	4.	10.
Chromium (Hexavalent) (see below, a)	µg/L	2.	8.	20.
Copper	µg/L	3.	12.	30.
Lead	µg/L	2.	8.	20.
Mercury	µg/L	0.04	0.16	0.4
Nickel	µg/L	5.	20.	50.
Selenium	µg/L	15.	60.	150.
Silver	µg/L	0.7	2.8	7.
Zinc	µg/L	20.	80.	200.
Cyanide (see below, b)	µg/L	1.	4.	10.
Total Chlorine Residual (For intermittent chlorine sources see below, c)	µg/L	2.	8.	60.
Ammonia (expressed as nitrogen)	µg/L	600.	2400.	6000.
Acute* Toxicity	TUa	N/A	0.3	N/A
Chronic* Toxicity	TUc	N/A	1.	N/A
Phenolic Compounds (non-chlorinated)	µg/L	30.	120.	300.
Chlorinated Phenolics	µg/L	1.	4.	10.
Endosulfan	µg/L	0.009	0.018	0.027
Endrin	µg/L	0.002	0.004	0.006
HCH*	µg/L	0.004	0.008	0.012
Radioactivity	Not to exceed limits specified in Title 17, Division 1, Chapter 5, Subchapter 4, Group 3, Article 3, Section 30253 of the California Code of Regulations. Reference to Section 30253 is prospective, including future changes to any incorporated provisions of federal law, as the changes take effect.			

* See Appendix I for definition of terms.

TABLE 1 (formerly TABLE B) Continued

Chemical	30-day Average (µg/L)	
	Decimal Notation	Scientific Notation
OBJECTIVES FOR PROTECTION OF HUMAN HEALTH – NONCARCINOGENS		
acrolein	220.	2.2×10^2
antimony	1,200.	1.2×10^3
bis(2-chloroethoxy) methane	4.4	4.4×10^0
bis(2-chloroisopropyl) ether	1,200.	1.2×10^3
chlorobenzene	570.	5.7×10^2
chromium (III)	190,000.	1.9×10^5
di-n-butyl phthalate	3,500.	3.5×10^3
dichlorobenzenes*	5,100.	5.1×10^3
diethyl phthalate	33,000.	3.3×10^4
dimethyl phthalate	820,000.	8.2×10^5
4,6-dinitro-2-methylphenol	220.	2.2×10^2
2,4-dinitrophenol	4.0	4.0×10^0
ethylbenzene	4,100.	4.1×10^3
fluoranthene	15.	1.5×10^1
hexachlorocyclopentadiene	58.	5.8×10^1
nitrobenzene	4.9	4.9×10^0
thallium	2.	$2. \times 10^0$
toluene	85,000.	8.5×10^4
tributyltin	0.0014	1.4×10^{-3}
1,1,1-trichloroethane	540,000.	5.4×10^5
OBJECTIVES FOR PROTECTION OF HUMAN HEALTH – CARCINOGENS		
acrylonitrile	0.10	1.0×10^{-1}
aldrin	0.000022	2.2×10^{-5}
benzene	5.9	5.9×10^0
benzidine	0.000069	6.9×10^{-5}
beryllium	0.033	3.3×10^{-2}
bis(2-chloroethyl) ether	0.045	4.5×10^{-2}
bis(2-ethylhexyl) phthalate	3.5	3.5×10^0
carbon tetrachloride	0.90	9.0×10^{-1}
chlordane*	0.000023	2.3×10^{-5}
chlorodibromomethane	8.6	8.6×10^0

* See Appendix I for definition of terms.

TABLE 1 (formerly TABLE B) Continued

Chemical	30-day Average (µg/L)	
	Decimal Notation	Scientific Notation
OBJECTIVES FOR PROTECTION OF HUMAN HEALTH – CARCINOGENS		
chloroform	130.	1.3×10^2
DDT*	0.00017	1.7×10^{-4}
1,4-dichlorobenzene	18.	1.8×10^1
3,3'-dichlorobenzidine	0.0081	8.1×10^{-3}
1,2-dichloroethane	28.	2.8×10^1
1,1-dichloroethylene	0.9	9×10^{-1}
dichlorobromomethane	6.2	6.2×10^0
dichloromethane	450.	4.5×10^2
1,3-dichloropropene	8.9	8.9×10^0
dieldrin	0.00004	4.0×10^{-5}
2,4-dinitrotoluene	2.6	2.6×10^0
1,2-diphenylhydrazine	0.16	1.6×10^{-1}
halomethanes*	130.	1.3×10^2
heptachlor	0.00005	5×10^{-5}
heptachlor epoxide	0.00002	2×10^{-5}
hexachlorobenzene	0.00021	2.1×10^{-4}
hexachlorobutadiene	14.	1.4×10^1
hexachloroethane	2.5	2.5×10^0
isophorone	730.	7.3×10^2
N-nitrosodimethylamine	7.3	7.3×10^0
N-nitrosodi-N-propylamine	0.38	3.8×10^{-1}
N-nitrosodiphenylamine	2.5	2.5×10^0
PAHs*	0.0088	8.8×10^{-3}
PCBs*	0.000019	1.9×10^{-5}
TCDD equivalents*	0.0000000039	3.9×10^{-9}
1,1,2,2-tetrachloroethane	2.3	2.3×10^0
tetrachloroethylene	2.0	2.0×10^0
toxaphene	0.00021	2.1×10^{-4}
trichloroethylene	27.	2.7×10^1
1,1,2-trichloroethane	9.4	9.4×10^0
2,4,6-trichlorophenol	0.29	2.9×10^{-1}
vinyl chloride	36.	3.6×10^1

* See Appendix I for definition of terms.

Table 1 Notes:

- a) Dischargers may at their option meet this objective as a total chromium objective.
- b) If a discharger can demonstrate to the satisfaction of the Regional Water Board (subject to EPA approval) that an analytical method is available to reliably distinguish between strongly and weakly complexed cyanide, effluent limitations for cyanide may be met by the combined measurement of free cyanide, simple alkali metal cyanides, and weakly complexed organometallic cyanide complexes. In order for the analytical method to be acceptable, the recovery of free cyanide from metal complexes must be comparable to that achieved by the approved method in 40 CFR PART 136, as revised May 14, 1999.
- c) Water quality objectives for total chlorine residual applying to intermittent discharges not exceeding two hours, shall be determined through the use of the following equation:

$$\log y = -0.43 (\log x) + 1.8$$

where: y = the water quality objective (in µg/L) to apply when chlorine is being discharged;
x = the duration of uninterrupted chlorine discharge in minutes.

E. Biological Characteristics

- 1. Marine communities, including vertebrate, invertebrate, and plant species, shall not be degraded*.
- 2. The natural taste, odor, and color of fish, shellfish*, or other marine resources used for human consumption shall not be altered.
- 3. The concentration of organic materials in fish, shellfish* or other marine resources used for human consumption shall not bioaccumulate to levels that are harmful to human health.

F. Radioactivity

- 1. Discharge of radioactive waste* shall not degrade* marine life.

* See Appendix I for definition of terms.

III. PROGRAM OF IMPLEMENTATION

A. General Provisions

1. Effective Date
 - a. The *Water Quality Control Plan, Ocean Waters of California, California Ocean Plan* was adopted and has been effective since 1972. There have been multiple amendments of the Ocean Plan since its adoption.
2. General Requirements For Management Of Waste Discharge To The Ocean*
 - a. Waste* management systems that discharge to the ocean* must be designed and operated in a manner that will maintain the indigenous marine life and a healthy and diverse marine community.
 - b. Waste discharged* to the ocean* must be essentially free of:
 - (1) Material that is floatable or will become floatable upon discharge.
 - (2) Settleable material or substances that may form sediments which will degrade* benthic communities or other aquatic life.
 - (3) Substances which will accumulate to toxic levels in marine waters, sediments or biota.
 - (4) Substances that significantly* decrease the natural* light to benthic communities and other marine life.
 - (5) Materials that result in aesthetically undesirable discoloration of the ocean* surface.
 - c. Waste* effluents shall be discharged in a manner which provides sufficient initial* dilution to minimize the concentrations of substances not removed in the treatment.
 - d. Location of waste* discharges must be determined after a detailed assessment of the oceanographic characteristics and current patterns to assure that:
 - (1) Pathogenic organisms and viruses are not present in areas where shellfish* are harvested for human consumption or in areas used for swimming or other body-contact sports.
 - (2) Natural water quality conditions are not altered in areas designated as being of special biological significance or areas that existing marine laboratories use as a source of seawater.
 - (3) Maximum protection is provided to the marine environment.

* See Appendix I for definition of terms.

- e. Waste* that contains pathogenic organisms or viruses should be discharged a sufficient distance from shellfishing* and water-contact sports areas to maintain applicable bacterial standards without disinfection. Where conditions are such that an adequate distance cannot be attained, reliable disinfection in conjunction with a reasonable separation of the discharge point from the area of use must be provided. Disinfection procedures that do not increase effluent toxicity and that constitute the least environmental and human hazard should be used.

3. Areas of Special Biological Significance

- a. ASBS* shall be designated by the State Water Board following the procedures provided in Appendix IV. A list of ASBS* is available in Appendix V.

4. Combined Sewer Overflow: Notwithstanding any other provisions in this plan, discharges from the City of San Francisco's combined sewer system are subject to the US EPA's Combined Sewer Overflow Policy.

B. Table 2 Effluent Limitations

TABLE 2 (formerly TABLE A) EFFLUENT LIMITATIONS				
		Limiting Concentrations		
	Unit of Measurement	Monthly (30-day Average)	Weekly (7-day Average)	Maximum at any time
Grease and Oil	mg/L	25.	40.	75.
Suspended Solids			See below +	
Settleable Solids	mL/L	1.0	1.5	3.0
Turbidity	NTU	75.	100.	225.
pH	Units		Within limit of 6.0 to 9.0 at all times	

Table 2 Notes:

- + Suspended Solids: Dischargers shall, as a 30-day average, remove 75% of suspended solids from the influent stream before discharging wastewaters to the ocean*, except that the effluent limitation to be met shall not be lower than 60 mg/l. Regional Boards may recommend that the State Water Board (Chapter III.J), with the concurrence of the Environmental Protection Agency, adjust the lower effluent concentration limit (the 60 mg/l above) to suit the environmental and effluent characteristics of the discharge. As a further consideration in making such recommendation for adjustment, Regional Water Boards should evaluate effects on existing and potential water* reclamation projects.

If the lower effluent concentration limit is adjusted, the discharger shall remove 75% of suspended solids from the influent stream at any time the influent concentration exceeds four times such adjusted effluent limit.

1. Table 2 effluent limitations apply only to publicly owned treatment works and industrial discharges for which Effluent Limitations Guidelines have not been established pursuant to Sections 301, 302, 304, or 306 of the Federal Clean Water Act.

* See Appendix I for definition of terms.

2. Table 2 effluent limitations shall apply to a discharger's total effluent, of whatever origin (i.e., gross, not net, discharge), except where otherwise specified in this Plan.
3. The State Water Board is authorized to administer and enforce effluent limitations established pursuant to the Federal Clean Water Act. Effluent limitations established under Sections 301, 302, 306, 307, 316, 403, and 405 of the aforementioned Federal Act and administrative procedures pertaining thereto are included in this plan by reference. Compliance with Table 2 effluent limitations, or Environmental Protection Agency Effluent Limitations Guidelines for industrial discharges, based on Best Practicable Control Technology, shall be the minimum level of treatment acceptable under this plan, and shall define reasonable treatment and waste control technology.

C. Implementation Provisions for Table 1

1. Effluent concentrations calculated from Table 1 water quality objectives shall apply to a discharger's total effluent, of whatever origin (i.e., gross, not net, discharge), except where otherwise specified in this Plan.
2. If the Regional Water Board determines, using the procedures in Appendix VI, that a pollutant is discharged into ocean* waters at levels which will cause, have the reasonable potential to cause, or contribute to an excursion above a Table 1 water quality objective, the Regional Water Board shall incorporate a water quality-based effluent limitation in the Waste Discharge Requirement for the discharge of that pollutant.
3. Effluent limitations shall be imposed in a manner prescribed by the State Water Board such that the concentrations set forth below as water quality objectives shall not be exceeded in the receiving water* upon completion of initial* dilution, except that objectives indicated for radioactivity shall apply directly to the undiluted waste* effluent.
4. Calculation of Effluent Limitations
 - a. Effluent limitations for water quality objectives listed in Table 1, with the exception of acute* toxicity and radioactivity, shall be determined through the use of the following equation:

Equation 1: $C_e = C_o + D_m (C_o - C_s)$

where:

C_e = the effluent concentration limit, $\mu\text{g/L}$

C_o = the concentration (water quality objective) to be met at the completion of initial* dilution, $\mu\text{g/L}$

C_s = background seawater concentration (see Table 3 below, with all metals expressed as total recoverable concentrations), $\mu\text{g/L}$

D_m = minimum probable initial* dilution expressed as parts seawater per part wastewater.

* See Appendix I for definition of terms.

**TABLE 3 (formerly TABLE C)
BACKGROUND SEAWATER CONCENTRATIONS (Cs)**

Waste Constituent	Cs (µg/L)
Arsenic	3.
Copper	2.
Mercury	0.0005
Silver	0.16
Zinc	8.
For all other Table 1 parameters, Cs = 0.	

b. Determining a Mixing Zone for the Acute* Toxicity Objective

The mixing zone for the acute* toxicity objective shall be ten percent (10%) of the distance from the edge of the outfall structure to the edge of the chronic mixing zone (zone of initial dilution). There is no vertical limitation on this zone. The effluent limitation for the acute* toxicity objective listed in Table 1 shall be determined through the use of the following equation:

Equation 2: $C_e = C_a + (0.1) D_m (C_a)$

where:

C_a = the concentration (water quality objective) to be met at the edge of the acute mixing zone.

D_m = minimum probable initial* dilution expressed as parts seawater per part wastewater (This equation applies only when $D_m > 24$).

c. Toxicity Testing Requirements based on the Minimum Initial* Dilution Factor for Ocean Waste Discharges

- (1) Dischargers shall conduct acute* toxicity testing if the minimum initial* dilution of the effluent is greater than 1,000:1 at the edge of the mixing zone.
- (2) Dischargers shall conduct either acute* or chronic* toxicity testing if the minimum initial* dilution ranges from 350:1 to 1,000:1 depending on the specific discharge conditions. The Regional Water Board shall make this determination.
- (3) Dischargers shall conduct chronic* toxicity testing for ocean waste discharges with minimum initial* dilution factors ranging from 100:1 to 350:1. The Regional Water Board may require that acute toxicity testing be conducted in addition to chronic as necessary for the protection of beneficial uses of ocean waters.
- (4) Dischargers shall conduct chronic toxicity testing if the minimum initial* dilution of the effluent falls below 100:1 at the edge of the mixing zone.

* See Appendix I for definition of terms.

- d. For the purpose of this Plan, minimum initial* dilution is the lowest average initial* dilution within any single month of the year. Dilution estimates shall be based on observed waste flow characteristics, observed receiving water* density structure, and the assumption that no currents, of sufficient strength to influence the initial* dilution process, flow across the discharge structure.
- e. The Executive Director of the State Water Board shall identify standard dilution models for use in determining Dm, and shall assist the Regional Board in evaluating Dm for specific waste discharges. Dischargers may propose alternative methods of calculating Dm, and the Regional Board may accept such methods upon verification of its accuracy and applicability.
- f. The six-month median shall apply as a moving median of daily values for any 180-day period in which daily values represent flow weighted average concentrations within a 24-hour period. For intermittent discharges, the daily value shall be considered to equal zero for days on which no discharge occurred.
- g. The daily maximum shall apply to flow weighted 24 hour composite samples.
- h. The instantaneous maximum shall apply to grab sample determinations.
- i. If only one sample is collected during the time period associated with the water quality objective (e.g., 30-day average or 6-month median), the single measurement shall be used to determine compliance with the effluent limitation for the entire time period.
- j. Discharge requirements shall also specify effluent limitations in terms of mass emission rate limits utilizing the general formula:

$$\text{Equation 3: lbs/day} = 0.00834 \times C_e \times Q$$

where:

C_e = the effluent concentration limit, $\mu\text{g/L}$

Q = flow rate, million gallons per day (MGD)

- k. The six-month median limit on daily mass emissions shall be determined using the six-month median effluent concentration as C_e and the observed flow rate Q in millions of gallons per day. The daily maximum mass emission shall be determined using the daily maximum effluent concentration limit as C_e and the observed flow rate Q in millions of gallons per day.
 - l. Any significant change in waste* flow shall be cause for reevaluating effluent limitations.
5. Minimum* Levels

For each numeric effluent limitation, the Regional Board must select one or more Minimum* Levels (and their associated analytical methods) for inclusion in the permit.

* See Appendix I for definition of terms.

The “reported” Minimum* Level is the Minimum* Level (and its associated analytical method) chosen by the discharger for reporting and compliance determination from the Minimum* Levels included in their permit.

a. Selection of Minimum* Levels from Appendix II

The Regional Water Board must select all Minimum* Levels from Appendix II that are below the effluent limitation. If the effluent limitation is lower than all the Minimum* Levels in Appendix II, the Regional Board must select the lowest Minimum* Level from Appendix II.

b. Deviations from Minimum* Levels in Appendix II

The Regional Board, in consultation with the State Water Board’s Quality Assurance Program, must establish a Minimum* Level to be included in the permit in any of the following situations:

1. A pollutant is not listed in Appendix II.
2. The discharger agrees to use a test method that is more sensitive than those described in 40 CFR 136 (revised May 14, 1999).
3. The discharger agrees to use a Minimum* Level lower than those listed in Appendix II.
4. The discharger demonstrates that their calibration standard matrix is sufficiently different from that used to establish the Minimum* Level in Appendix II and proposes an appropriate Minimum* Level for their matrix.
5. A discharger uses an analytical method having a quantification practice that is not consistent with the definition of Minimum* Level (e.g., US EPA methods 1613, 1624, 1625).

6. Use of Minimum* Levels

- a. Minimum* Levels in Appendix II represent the lowest quantifiable concentration in a sample based on the proper application of method-specific analytical procedures and the absence of matrix interferences. Minimum* Levels also represent the lowest standard concentration in the calibration curve for a specific analytical technique after the application of appropriate method-specific factors.

Common analytical practices may require different treatment of the sample relative to the calibration standard. Some examples are given below:

<u>Substance or Grouping</u>	<u>Method-Specific Treatment</u>	<u>Most Common Factor</u>
Volatile Organics	No differential treatment	1
Semi-Volatile Organics	Samples concentrated by extraction	1000
Metals	Samples diluted or concentrated	½, 2, and 4
Pesticides	Samples concentrated by extraction	100

- b. Other factors may be applied to the Minimum* Level depending on the specific sample preparation steps employed. For example, the treatment typically applied when there are matrix effects is to dilute the sample or sample aliquot by a factor

* See Appendix I for definition of terms.

of ten. In such cases, this additional factor must be applied during the computation of the reporting limit. Application of such factors will alter the reported Minimum* Level.

- c. Dischargers are to instruct their laboratories to establish calibration standards so that the Minimum* Level (or its equivalent if there is differential treatment of samples relative to calibration standards) is the lowest calibration standard. At no time is the discharger to use analytical data derived from *extrapolation* beyond the lowest point of the calibration curve. In accordance with Section 4b, above, the discharger's laboratory may employ a calibration standard lower than the Minimum* Level in Appendix II.

7. Sample Reporting Protocols

- a. Dischargers must report with each sample result the reported Minimum* Level (selected in accordance with Section 4, above) and the laboratory's current MDL*.
- b. Dischargers must also report the results of analytical determinations for the presence of chemical constituents in a sample using the following reporting protocols:
 - (1) Sample results greater than or equal to the reported Minimum* Level must be reported "as measured" by the laboratory (i.e., the measured chemical concentration in the sample).
 - (2) Sample results less than the reported Minimum* Level, but greater than or equal to the laboratory's MDL*, must be reported as "Detected, but Not Quantified", or DNQ. The laboratory must write the estimated chemical concentration of the sample next to DNQ as well as the words "Estimated Concentration" (may be shortened to "Est. Conc.").
 - (3) Sample results less than the laboratory's MDL* must be reported as "Not Detected", or ND.

8. Compliance Determination

Sufficient sampling and analysis shall be required to determine compliance with the effluent limitation.

a. Compliance with Single-Constituent Effluent Limitations

Dischargers are out of compliance with the effluent limitation if the concentration of the pollutant (see Section 7c, below) in the monitoring sample is greater than the effluent limitation and greater than or equal to the reported Minimum* Level.

b. Compliance with Effluent Limitations expressed as a Sum of Several Constituents

Dischargers are out of compliance with an effluent limitation which applies to the sum of a group of chemicals (e.g., PCB's) if the sum of the individual pollutant concentrations is greater than the effluent limitation. Individual pollutants of the group will be considered to have a concentration of zero if the constituent is reported as ND or DNQ.

c. Multiple Sample Data Reduction

* See Appendix I for definition of terms.

The concentration of the pollutant in the effluent may be estimated from the result of a single sample analysis or by a measure of central tendency (arithmetic mean, geometric mean, median, etc.) of multiple sample analyses when all sample results are quantifiable (i.e., greater than or equal to the reported Minimum* Level). When one or more sample results are reported as ND or DNQ, the central tendency concentration of the pollutant shall be the median (middle) value of the multiple samples. If, in an even number of samples, one or both of the middle values is ND or DNQ, the median will be the lower of the two middle values.

d. Powerplants and Heat Exchange Dischargers

Due to the large total volume of powerplant and other heat exchange discharges, special procedures must be applied for determining compliance with Table 1 objectives on a routine basis. Effluent concentration values (C_e) shall be determined through the use of equation 1 considering the minimal probable initial* dilution of the combined effluent (in-plant waste streams plus cooling water flow). These concentration values shall then be converted to mass emission limitations as indicated in equation 3. The mass emission limits will then serve as requirements applied to all inplant waste* streams taken together which discharge into the cooling water flow, except that limits for total chlorine residual, acute* (if applicable per Section (3)(c)) and chronic* toxicity and instantaneous maximum concentrations in Table 1 shall apply to, and be measured in, the combined final effluent, as adjusted for dilution with ocean water. The Table 1 objective for radioactivity shall apply to the undiluted combined final effluent.

9. Pollutant Minimization Program

a. Pollutant Minimization Program Goal

The goal of the Pollutant Minimization Program is to reduce all potential sources of a pollutant through pollutant minimization (control) strategies, including pollution prevention measures, in order to maintain the effluent concentration at or below the effluent limitation.

Pollution prevention measures may be particularly appropriate for persistent bioaccumulative priority pollutants where there is evidence that beneficial uses are being impacted. The completion and implementation of a Pollution Prevention Plan, required in accordance with CA Water Code Section 13263.3 (d) will fulfill the Pollution Minimization Program requirements in this section.

b. Determining the need for a Pollutant Minimization Program

1. The discharger must develop and conduct a Pollutant Minimization Program if all of the following conditions are true:
 - (a) The calculated effluent limitation is less than the reported Minimum* Level
 - (b) The concentration of the pollutant is reported as DNQ

* See Appendix I for definition of terms.

- (c) There is evidence showing that the pollutant is present in the effluent above the calculated effluent limitation.
- 2. Alternatively, the discharger must develop and conduct a Pollutant Minimization Program if all of the following conditions are true:
 - (a) The calculated effluent limitation is less than the Method Detection Limit*.
 - (b) The concentration of the pollutant is reported as ND.
 - (c) There is evidence showing that the pollutant is present in the effluent above the calculated effluent limitation.
- c. Regional Water Boards may include special provisions in the discharge requirements to require the gathering of evidence to determine whether the pollutant is present in the effluent at levels above the calculated effluent limitation. Examples of evidence may include:
 - 1. health advisories for fish consumption,
 - 2. presence of whole effluent toxicity,
 - 3. results of benthic or aquatic organism tissue sampling,
 - 4. sample results from analytical methods more sensitive than methods included in the permit (in accordance with Section 4b, above).
 - 5. the concentration of the pollutant is reported as DNQ and the effluent limitation is less than the MDL
- d. Elements of a Pollutant Minimization Program

The Regional Board may consider cost-effectiveness when establishing the requirements of a Pollutant Minimization Program. The program shall include actions and submittals acceptable to the Regional Board including, but not limited to, the following:

 - 1. An annual review and semi-annual monitoring of potential sources of the reportable pollutant, which may include fish tissue monitoring and other bio-uptake sampling;
 - 2. Quarterly monitoring for the reportable pollutant in the influent to the wastewater treatment system;
 - 3. Submittal of a control strategy designed to proceed toward the goal of maintaining concentrations of the reportable pollutant in the effluent at or below the calculated effluent limitation;
 - 4. Implementation of appropriate cost-effective control measures for the pollutant, consistent with the control strategy; and,
 - 5. An annual status report that shall be sent to the Regional Board including:
 - (a) All Pollutant Minimization Program monitoring results for the previous year;
 - (b) A list of potential sources of the reportable pollutant;

* See Appendix I for definition of terms.

- (c) A summary of all action taken in accordance with the control strategy;
and,
- (d) A description of actions to be taken in the following year.

10. Toxicity Reduction Requirements

- a. If a discharge consistently exceeds an effluent limitation based on a toxicity objective in Table 1, a toxicity reduction evaluation (TRE) is required. The TRE shall include all reasonable steps to identify the source of toxicity. Once the source(s) of toxicity is identified, the discharger shall take all reasonable steps necessary to reduce toxicity to the required level.
- b. The following shall be incorporated into waste discharge requirements: (1) a requirement to conduct a TRE if the discharge consistently exceeds its toxicity effluent limitation, and (2) a provision requiring a discharger to take all reasonable steps to reduce toxicity once the source of toxicity is identified.

D. Implementation Provisions for Bacterial Characteristics

1. Water-Contact Monitoring

- a. Weekly samples shall be collected from each site. The geometric mean shall be calculated using the five most recent sample results.
- b. If a single sample exceeds any of the single sample maximum (SSM) standards, repeat sampling at that location shall be conducted to determine the extent and persistence of the exceedance. Repeat sampling shall be conducted within 24 hours of receiving analytical results and continued until the sample result is less than the SSM standard or until a sanitary survey is conducted to determine the source of the high bacterial densities.
 - i) Total coliform density will not exceed 10,000 per 100 mL; or
 - ii) Fecal coliform density will not exceed 400 per 100 mL; or
 - iii) Total coliform density will not exceed 1,000 per 100 mL when the ratio of fecal/total coliform exceeds 0.1;
 - iv) enterococcus density will not exceed 104 per 100 mL.

When repeat sampling is required because of an exceedance of any one single sample density, values from all samples collected during that 30-day period will be used to calculate the geometric mean.

- c. It is state policy that the geometric mean bacterial objectives are strongly preferred for use in water body assessment decisions, for example, in developing the Clean Water Act section 303(d) list of impaired waters, because the geometric mean objectives are a more reliable measure of long-term water body conditions. In making assessment decisions on bacterial quality, single sample maximum data must be considered together with any available geometric mean data. The use of only single sample maximum bacterial data is generally inappropriate unless there is a limited data set, the water is subject to short-term spikes in

* See Appendix I for definition of terms.

bacterial concentrations, or other circumstances justify the use of only single sample maximum data.

- d. For monitoring stations outside of the defined water-contact recreation zone (REC-1), samples will be analyzed for total coliform only.

E. Implementation Provisions for Marine Managed Areas*

1. Section E addresses the following Marine Managed Areas*:

(a) State Water Quality Protection Areas (SWQPAs)* consisting of:

- (1) SWQPA – Areas of Special Biological Significance (ASBS) designated by the State Water Board that require special protections as defined under section 4 below.
- (2) SWQPA – General Protection (GP) designated by the State Water Board to protect water quality within Marine Protected Areas (MPAs) that require protection under the provisions described under section 5 below.

(b) Marine Protected Areas as defined in the California Public Resources Code as State Marine Reserves, State Marine Parks and State Marine Conservation Areas, established by the Fish and Game Commission, or the Parks and Recreation Commission.

2. The designation of State Marine Parks and State Marine Conservation Areas may not serve as the sole basis for new or modified limitations, substantive conditions, or prohibitions upon existing municipal point source wastewater discharge outfalls. This provision does not apply to State Marine Reserves.

3. The State Water Board may designate SWQPAs* to prevent the undesirable alteration of natural water quality within MPAs. These designations may include either SWQPA-ASBS or SWQPA-GP or in combination. In considering the designation of SWQPAs over MPAs, the State Water Board will consult with the affected Regional Water Quality Control Board, the Department of Fish and Game and the Department of Parks and Recreation, in accordance with the requirements of Appendix IV.

4. Implementation Provisions For SWQPA-ASBS*

- (a) Waste* shall not be discharged to areas designated as being of special biological significance. Discharges shall be located a sufficient distance from such designated areas to assure maintenance of natural water quality conditions in these areas.
- (b) Regional Water Boards may approve waste discharge requirements or recommend certification for limited-term (i.e. weeks or months) activities in ASBS*. Limited-term activities include, but are not limited to, activities such as maintenance/repair of existing boat facilities, restoration of sea walls, repair of existing storm water pipes, and replacement/repair of existing bridges. Limited-

* See Appendix I for definition of terms.

term activities may result in temporary and short-term changes in existing water quality. Water quality degradation shall be limited to the shortest possible time. The activities must not permanently degrade water quality or result in water quality lower than that necessary to protect existing uses, and all practical means of minimizing such degradation shall be implemented.

5. Implementation Provisions for SWQPAs-GP*

(a) Implementation provisions for existing point source wastewater discharges (NPDES)

- (1) An SWQPA-GP shall not be designated over existing permitted point source wastewater outfalls or encroach upon the zone of initial dilution associated with an existing discharge. This requirement does not apply to discharges less than one million gallons per day.
- (2) Designation of an SWQPA-GP shall not include conditions to move existing point source wastewater outfalls.
- (3) Where a new SWQPA-GP is established in the vicinity of existing municipal wastewater outfalls, there shall be no new or modified limiting condition or prohibitions for the SWQPA-GP relative to those wastewater outfalls.
- (4) Regulatory requirements for discharges from existing treated municipal wastewater outfalls shall be derived from the Chapter II – Water Quality Objectives and Chapter III – Program of Implementation.

(b) Implementation provisions for existing seawater intakes

- (1) Existing permitted seawater intakes must be controlled to minimize entrainment and impingement by using best technology available. Existing permitted seawater intakes with a capacity less than one million gallons per day are excluded from this requirement.

(c) Implementation provisions for permitted separate storm sewer system (MS4) discharges and nonpoint source discharges.

- (1) Existing waste discharges are allowed, but shall not cause an undesirable alteration in natural water quality. For purposes of SWQPA-GP, an undesirable alteration in natural water quality means that for intermittent (e.g. wet weather) discharges, Table 1 instantaneous maximum concentrations for chemical constituents, and daily maximum concentrations for chronic toxicity, must not be exceeded in the receiving water.
- (2) An NPDES permitting authority may authorize NPDES-permitted non-storm water discharges to an MS4 with a direct discharge to an SWQPA-GP only to the extent the NPDES permitting authority finds that the discharge does not cause an undesirable alteration in natural water quality in an SWQPA-GP.

* See Appendix I for definition of terms.

- (3) Non-storm water (dry weather) flows are effectively prohibited as required by the applicable permit. Where capacity and infrastructure exists, all dry weather flows shall be diverted to municipal sanitary sewer systems. The permitting authority may allow discharges essential for emergency response purposes, structural stability, and slope stability, which may include but are not limited the following:
 - a. Discharges associated with emergency fire fighting operations.
 - b. Foundation and footing drains
 - c. Water from crawl space or basement pumps.
 - d. Hillside dewatering.
- (4) The following naturally occurring discharges are allowed:
 - a. Naturally occurring groundwater seepage via a storm drain
 - b. Non-anthropogenic flows from a naturally occurring stream via a culvert or storm drain, as long as there are no contributions of anthropogenic runoff.
- (5) Existing storm water discharges into an SWQPA-GP shall be characterized and assessed to determine what effect if any these inputs are having on natural water quality in the State Water Quality Protection Area. Such assessments shall include an evaluation of cumulative impacts as well as impacts stemming from individual discharges. Information to be considered shall include:
 - a. Water quality;
 - b. Flow;
 - c. Watershed pollutant sources; and
 - d. Intertidal and/ or subtidal biological surveys.

Within each SWQPA-GP the assessment shall be used to rank these existing discharges into low, medium and high threat impact categories. Cumulative impacts will be ranked similarly as well.

- (6) An initial analysis shall be performed for pre- and post-storm receiving water quality of Table 1 constituents and chronic toxicity. If post-storm receiving water quality has larger concentrations of constituents relative to pre-storm, and Table 1 instantaneous maximum concentrations for chemical constituents, and daily maximum concentrations for chronic toxicity, are exceeded, then receiving water shall be re-analyzed along with storm runoff (end of pipe) for the constituents that are exceeded.
- (7) If undesirable alterations of natural water quality and/or biological communities are identified, control strategies/measures shall be implemented for those dischargers characterized as a high threat or those contributing to higher threat cumulative impacts first.
- (8) If those strategies fail, additional control strategies/measures will be implemented for dischargers characterized as medium impact dischargers. If these strategies do not result in improvement of water quality, those discharges classified as low threat shall also implement control strategies/measures

* See Appendix I for definition of terms.

(d) Implementation Provisions for New Discharges

(1) Point Source Wastewater Outfalls

No new point source wastewater outfalls shall be established within an SWQPA-GP.

(2) Seawater intakes

No new surface water seawater intakes shall be established within an SWQPA-GP. This does not apply to sub-seafloor intakes where studies are prepared showing there is no predictable entrainment or impingement of marine life.

(3) All Other New Discharges

There shall be no increase in nonpoint sources or permitted storm drains directly into an SWQPA-GP.

6. Impaired Tributaries to MPAs, SWQPA-ASBS and SWQPA-GP

All water bodies draining to, or that are designated as, MPAs and SWQPAs that appear on the State's CWA Section 303(d) list shall be given a high priority to have a TMDL developed and implemented.

F. Revision of Waste* Discharge Requirements

1. The Regional Water Boards may establish more restrictive water quality objectives and effluent limitations than those set forth in this Plan as necessary for the protection of beneficial uses of ocean* waters.
2. Regional Water Boards may impose alternative less restrictive provisions than those contained within Table 1 of the Plan, provided an applicant can demonstrate that:
 - a. Reasonable control technologies (including source control, material substitution, treatment and dispersion) will not provide for complete compliance; or
 - b. Any less stringent provisions would encourage water* reclamation;
3. Provided further that:
 - a. Any alternative water quality objectives shall be below the conservative estimate of chronic* toxicity, as given in Table 4 (with all metal concentrations expressed as total recoverable concentrations), and such alternative will provide for adequate protection of the marine environment;
 - b. A receiving water* quality toxicity objective of 1 TUc is not exceeded; and
 - c. The State Water Board grants an exception (Chapter III.J.) to the Table 1 limits as established in the Regional Board findings and alternative limits.

* See Appendix I for definition of terms.

G. Compliance Schedules in National Pollutant Discharge Elimination System (NPDES) Permits

1. Compliance schedules in NPDES permits are authorized in accordance with the provisions of the State Water Board's Policy for Compliance Schedules in [NPDES] Permits (2008).

**TABLE 4 (formerly TABLE D)
CONSERVATIVE ESTIMATES OF CHRONIC TOXICITY**

Constituent	Estimate of Chronic Toxicity (µg/L)
Arsenic	19.
Cadmium	8.
Hexavalent Chromium	18.
Copper	5.
Lead	22.
Mercury	0.4
Nickel	48.
Silver	3.
Zinc	51.
Cyanide	10.
Total Chlorine Residual	10.0
Ammonia	4000.0
Phenolic Compounds (non-chlorinated)	a) (see below)
Chlorinated Phenolics	a)
Chlorinated Pesticides and PCB's	b)

Table 4 Notes:

- a) There are insufficient data for phenolics to estimate chronic toxicity levels. Requests for modification of water quality objectives for these waste* constituents must be supported by chronic toxicity data for representative sensitive species. In such cases, applicants seeking modification of water quality objectives should consult the Regional Water Quality Control Board to determine the species and test conditions necessary to evaluate chronic effects.
- b) Limitations on chlorinated pesticides and PCB's shall not be modified so that the total of these compounds is increased above the objectives in Table 1.

H. Monitoring Program

1. The Regional Water Boards shall require dischargers to conduct self-monitoring programs and submit reports necessary to determine compliance with the waste* discharge requirements, and may require dischargers to contract with agencies or persons acceptable to the Regional Water Board to provide monitoring reports.

* See Appendix I for definition of terms.

Monitoring provisions contained in waste discharge requirements shall be in accordance with the Monitoring Procedures provided in Appendices III and VI.

2. The Regional Water Board may require monitoring of bioaccumulation of toxicants in the discharge zone. Organisms and techniques for such monitoring shall be chosen by the Regional Water Board on the basis of demonstrated value in waste* discharge monitoring.

I. Discharge Prohibitions

1. Hazardous Substances

- a. The discharge of any radiological, chemical, or biological warfare agent or high-level radioactive waste* into the ocean* is prohibited.

2. Areas Designated for Special Water Quality Protection

- a. Waste* shall not be discharged to designated Areas* of Special Biological Significance except as provided in Chapter III. E. Implementation Provisions for Marine Managed Areas*.

3. Sludge

- a. Pipeline discharge of sludge to the ocean* is prohibited by federal law; the discharge of municipal and industrial waste* sludge directly to the ocean*, or into a waste* stream that discharges to the ocean*, is prohibited by this Plan. The discharge of sludge digester supernatant directly to the ocean*, or to a waste* stream that discharges to the ocean* without further treatment, is prohibited.
- b. It is the policy of the State Water Board that the treatment, use and disposal of sewage sludge shall be carried out in the manner found to have the least adverse impact on the total natural and human environment. Therefore, if federal law is amended to permit such discharge, which could affect California waters, the State Water Board may consider requests for exceptions to this section under Chapter III. J of this Plan, provided further that an Environmental Impact Report on the proposed project shows clearly that any available alternative disposal method will have a greater adverse environmental impact than the proposed project.

4. By-Passing

- a. The by-passing of untreated wastes* containing concentrations of pollutants in excess of those of Table 2 or Table 1 to the ocean* is prohibited.

5. Vessels

- a. Discharges of hazardous waste (as defined in California Health and Safety Code section 25117 et seq. [but not including sewage]), oily bilgewater, medical waste (as defined in section 117600 et seq. of the California Health and Safety Code) dry-cleaning waste, and film-processing waste from large passenger vessels and oceangoing vessels are prohibited.

* See Appendix I for definition of terms.

- b. Discharges of graywater* and sewage* from large passenger vessels are prohibited.
- c. Discharges of sewage and sewage sludge from vessels are prohibited in No Discharge Zones promulgated by U.S. EPA.

J. State Board Exceptions to Plan Requirements

- 1. The State Water Board may, in compliance with the California Environmental Quality Act, subsequent to a public hearing, and with the concurrence of the Environmental Protection Agency, grant exceptions where the Board determines:
 - a. The exception will not compromise protection of ocean* waters for beneficial uses, and,
 - b. The public interest will be served.
- 2. All exceptions issued by the State Water Board and in effect at the time of the Triennial Review will be reviewed at that time. If there is sufficient cause to re-open or revoke any exception, the State Water Board may direct staff to prepare a report and to schedule a public hearing. If after the public hearing the State Water Board decides to re-open, revoke, or re-issue a particular exception, it may do so at that time.

K. Implementation Provisions for Vessel Discharges

- 1. Vessel discharges must comply with State Lands Commission (SLC) requirements for ballast water discharges and hull fouling to control and prevent the introduction of non-indigenous species, found in the Public Resources Code sections 71200 et seq. and title 2, California Code of Regulations, section 22700 et. seq.
- 2. Discharges incidental to the normal operation large passenger vessels and ocean-going vessels must be covered and comply with an individual or general NPDES permit.
- 3. Vessel discharges must not result in violations of water quality objectives in this plan.
- 4. Vessels subject to the federal NPDES Vessel General Permit (VGP) which are not large passenger vessels must follow the best management practices for graywater* as required in the VGP, including the use of only those cleaning agents (e.g., soaps and detergents) that are phosphate-free, non-toxic, and non-bioaccumulative.

* See Appendix I for definition of terms.

APPENDIX I

DEFINITION OF TERMS

ACUTE TOXICITY

a. Acute Toxicity (TUa)

Expressed in Toxic Units Acute (TUa)

$$TUa = \frac{100}{96\text{-hr LC } 50\%}$$

b. Lethal Concentration 50% (LC 50)

LC 50 (percent waste giving 50% survival of test organisms) shall be determined by static or continuous flow bioassay techniques using standard marine test species as specified in Appendix III. If specific identifiable substances in wastewater can be demonstrated by the discharger as being rapidly rendered harmless upon discharge to the marine environment, but not as a result of dilution, the LC 50 may be determined after the test samples are adjusted to remove the influence of those substances.

When it is not possible to measure the 96-hour LC 50 due to greater than 50 percent survival of the test species in 100 percent waste, the toxicity concentration shall be calculated by the expression:

$$TUa = \frac{\log (100 - S)}{1.7}$$

where:

S = percentage survival in 100% waste. If S > 99, TUa shall be reported as zero.

AREAS OF SPECIAL BIOLOGICAL SIGNIFICANCE (ASBS) are those areas designated by the State Water Board as ocean areas requiring protection of species or biological communities to the extent that maintenance of natural water quality is assured. All Areas of Special Biological Significance are also classified as a subset of STATE WATER QUALITY PROTECTION AREAS. ASBS are also referred to as State Water Quality Protection Areas – Areas of Special Biological Significance (SWQPA-ASBS).

CHLORDANE shall mean the sum of chlordane-alpha, chlordane-gamma, chlordene-alpha, chlordene-gamma, nonachlor-alpha, nonachlor-gamma, and oxychlordane.

CHRONIC TOXICITY: This parameter shall be used to measure the acceptability of waters for supporting a healthy marine biota until improved methods are developed to evaluate biological response.

a. Chronic Toxicity (TUc)

Expressed as Toxic Units Chronic (TUc)

* See Appendix I for definition of terms.

$$TUc = \frac{100}{NOEL}$$

b. No Observed Effect Level (NOEL)

The NOEL is expressed as the maximum percent effluent or receiving water* that causes no observable effect on a test organism, as determined by the result of a critical life stage toxicity test listed in Appendix III, Table III-1.

DDT shall mean the sum of 4,4'DDT, 2,4'DDT, 4,4'DDE, 2,4'DDE, 4,4'DDD, and 2,4'DDD.

DEGRADE: Degradation shall be determined by comparison of the waste field and reference site(s) for characteristic species diversity, population density, contamination, growth anomalies, debility, or supplanting of normal species by undesirable plant and animal species. Degradation occurs if there are significant differences in any of three major biotic groups, namely, demersal fish, benthic invertebrates, or attached algae. Other groups may be evaluated where benthic species are not affected, or are not the only ones affected.

DICHLOROBENZENES shall mean the sum of 1,2- and 1,3-dichlorobenzene.

DOWNSTREAM OCEAN WATERS shall mean waters downstream with respect to ocean currents.

DREDGED MATERIAL: Any material excavated or dredged from the navigable waters of the United States, including material otherwise referred to as "spoil".

ENCLOSED BAYS are indentations along the coast which enclose an area of oceanic water within distinct headlands or harbor works. Enclosed bays include all bays where the narrowest distance between headlands or outermost harbor works is less than 75 percent of the greatest dimension of the enclosed portion of the bay. This definition includes but is not limited to: Humboldt Bay, Bodega Harbor, Tomales Bay, Drakes Estero, San Francisco Bay, Morro Bay, Los Angeles Harbor, Upper and Lower Newport Bay, Mission Bay, and San Diego Bay.

ENDOSULFAN shall mean the sum of endosulfan-alpha and -beta and endosulfan sulfate.

ESTUARIES AND COASTAL LAGOONS are waters at the mouths of streams that serve as mixing zones for fresh and ocean waters during a major portion of the year. Mouths of streams that are temporarily separated from the ocean by sandbars shall be considered as estuaries. Estuarine waters will generally be considered to extend from a bay or the open ocean to the upstream limit of tidal action but may be considered to extend seaward if significant mixing of fresh and salt water occurs in the open coastal waters. The waters described by this definition include but are not limited to the Sacramento-San Joaquin Delta as defined by Section 12220 of the California Water Code, Suisun Bay, Carquinez Strait downstream to Carquinez Bridge, and appropriate areas of the Smith, Klamath, Mad, Eel, Noyo, and Russian Rivers.

* See Appendix I for definition of terms.

GRAYWATER is drainage from galley, dishwasher, shower, laundry, bath, and lavatory wash basin sinks, and water fountains, but does not include drainage from toilets, urinals, hospitals, or cargo spaces.

HALOMETHANES shall mean the sum of bromoform, bromomethane (methyl bromide) and chloromethane (methyl chloride).

HCH shall mean the sum of the alpha, beta, gamma (lindane) and delta isomers of hexachlorocyclohexane.

INDICATOR BACTERIA includes total coliform bacteria, fecal coliform bacteria (or *E. coli*), and/or Enterococcus bacteria.

INITIAL DILUTION is the process which results in the rapid and irreversible turbulent mixing of wastewater with ocean water around the point of discharge.

For a submerged buoyant discharge, characteristic of most municipal and industrial wastes that are released from the submarine outfalls, the momentum of the discharge and its initial buoyancy act together to produce turbulent mixing. Initial dilution in this case is completed when the diluting wastewater ceases to rise in the water column and first begins to spread horizontally.

For shallow water submerged discharges, surface discharges, and nonbuoyant discharges, characteristic of cooling water wastes and some individual discharges, turbulent mixing results primarily from the momentum of discharge. Initial dilution, in these cases, is considered to be completed when the momentum induced velocity of the discharge ceases to produce significant mixing of the waste, or the diluting plume reaches a fixed distance from the discharge to be specified by the Regional Board, whichever results in the lower estimate for initial dilution.

KELP BEDS, for purposes of the bacteriological standards of this plan, are significant aggregations of marine algae of the genera Macrocystis and Nereocystis. Kelp beds include the total foliage canopy of Macrocystis and Nereocystis plants throughout the water column.

LARGE PASSENGER VESSELS are vessels of 300 gross registered tons or greater engaged in carrying passengers for hire. The following vessels are not large passenger vessels:

- (1) Vessels without berths or overnight accommodations for passengers;
- (2) Noncommercial vessels, warships, vessels operated by nonprofit entities as determined by the Internal Revenue Service, and vessels operated by the state, the United States, or a foreign government;
- (3) Oceangoing vessels, as defined below (e.g. those used to transport cargo).

MARICULTURE is the culture of plants and animals in marine waters independent of any pollution source.

MARINE MANAGED AREAS are named, discrete geographic marine or estuarine areas along the California coast designated by law or administrative action, and intended to protect, conserve, or otherwise manage a variety of resources and their uses. According to the California Public Resources Code (sections 36600 et. seq.) there are six classifications of

* See Appendix I for definition of terms.

marine managed areas, including State Marine Reserves, State Marine Parks and State Marine Conservation Areas, State Marine Cultural Preservation Areas, State Marine Recreational Management Areas, and State Water Quality Protection Areas.

MATERIAL: (a) In common usage: (1) the substance or substances of which a thing is made or composed (2) substantial; (b) For purposes of this Ocean Plan relating to waste disposal, dredging and the disposal of dredged material and fill, MATERIAL means matter of any kind or description which is subject to regulation as waste, or any material dredged from the navigable waters of the United States. See also, DREDGED MATERIAL.

MDL (Method Detection Limit) is the minimum concentration of a substance that can be measured and reported with 99% confidence that the analyte concentration is greater than zero, as defined in 40 CFR PART 136 Appendix B.

MINIMUM LEVEL (ML) is the concentrations at which the entire analytical system must give a recognizable signal and acceptable calibration point. The ML is the concentration in a sample that is equivalent to the concentration of the lowest calibration standard analyzed by a specific analytical procedure, assuming that all the method-specified sample weights, volumes and processing steps have been followed.

NATURAL LIGHT: Reduction of natural light may be determined by the Regional Board by measurement of light transmissivity or total irradiance, or both, according to the monitoring needs of the Regional Board.

NO DISCHARGE ZONE (NDZ) is an area in which both treated and untreated sewage discharges from vessels are prohibited. Within NDZ boundaries, vessel operators are required to retain their sewage discharges onboard for disposal at sea (beyond three miles from shore) or onshore at a pump-out facility.

NON-STORM WATER DISCHARGE is any runoff that is not the result of a precipitation event. This is often referred to as “dry weather flow.”

OCEAN WATERS are the territorial marine waters of the State as defined by California law to the extent these waters are outside of enclosed bays, estuaries, and coastal lagoons. If a discharge outside the territorial waters of the State could affect the quality of the waters of the State, the discharge may be regulated to assure no violation of the Ocean Plan will occur in ocean waters.

OCEANGOING VESSELS (i.e., oceangoing ships) means commercial vessels of 300 gross registered tons or more calling on California ports or places, excluding active military vessels.

OILY BILGE WATER includes bilge water that contains used lubrication oils, oil sludge and slops, fuel and oil sludge, used oil, used fuel and fuel filters, and oily waste.

PAHs (polynuclear aromatic hydrocarbons) shall mean the sum of acenaphthylene, anthracene, 1,2-benzanthracene, 3,4-benzofluoranthene, benzo[k]fluoranthene, 1,12-benzoperylene, benzo[a]pyrene, chrysene, dibenzo[ah]anthracene, fluorene, indeno[1,2,3-cd]pyrene, phenanthrene and pyrene.

* See Appendix I for definition of terms.

PCBs (polychlorinated biphenyls) shall mean the sum of chlorinated biphenyls whose analytical characteristics resemble those of Aroclor-1016, Aroclor-1221, Aroclor-1232, Aroclor-1242, Aroclor-1248, Aroclor-1254 and Aroclor-1260.

PERMITTING AUTHORITY means the State Water Board or Regional Water Board, whichever issues the permit.

RECEIVING WATER, for permitted storm water discharges and nonpoint sources, should be measured at the point of discharge(s), in the surf zone immediately where runoff from an outfall meets the ocean water (a.k.a., at point zero).

SHELLFISH are organisms identified by the California Department of Public Health as shellfish for public health purposes (i.e., mussels, clams and oysters).

SIGNIFICANT difference is defined as a statistically significant difference in the means of two distributions of sampling results at the 95 percent confidence level.

STATE WATER QUALITY PROTECTION AREAS (SWQPAs) are nonterrestrial marine or estuarine areas designated to protect marine species or biological communities from an undesirable alteration in natural water quality. All Areas of Special Biological Significance (ASBS) that were previously designated by the State Water Board in Resolutions 74-28, 74-32, and 75-61 are now also classified as a subset of State Water Quality Protection Areas and require special protections afforded by this Plan.

STATE WATER QUALITY PROTECTION AREAS – GENERAL PROTECTION (SWQPA-GP) designated by the State Water Board to protect marine species and biological communities from an undesirable alteration in natural water quality within State Marine Parks and State Marine Conservation Areas.

TCDD EQUIVALENTS shall mean the sum of the concentrations of chlorinated dibenzodioxins (2,3,7,8-CDDs) and chlorinated dibenzofurans (2,3,7,8-CDFs) multiplied by their respective toxicity factors, as shown in the table below.

* See Appendix I for definition of terms.

Isomer Group	Toxicity Equivalence Factor
	1.0
2,3,7,8-tetra CDD	
2,3,7,8-penta CDD	0.5
2,3,7,8-hexa CDDs	0.1
2,3,7,8-hepta CDD	0.01
octa CDD	0.001
2,3,7,8 tetra CDF	0.1
1,2,3,7,8 penta CDF	0.05
2,3,4,7,8 penta CDF	0.5
2,3,7,8 hexa CDFs	0.1
2,3,7,8 hepta CDFs	0.01
octa CDF	0.001

WASTE: As used in this Plan, waste includes a discharger's total discharge, of whatever origin, i.e., gross, not net, discharge.

WATER RECLAMATION: The treatment of wastewater to render it suitable for reuse, the transportation of treated wastewater to the place of use, and the actual use of treated wastewater for a direct beneficial use or controlled use that would not otherwise occur.

* See Appendix I for definition of terms.

APPENDIX II MINIMUM* LEVELS

The Minimum* Levels identified in this appendix represent the lowest concentration of a pollutant that can be quantitatively measured in a sample given the current state of performance in analytical chemistry methods in California. These Minimum* Levels were derived from data provided by state-certified analytical laboratories in 1997 and 1998 for pollutants regulated by the California Ocean Plan and shall be used until new values are adopted by the State Water Board. There are four major chemical groupings: volatile chemicals, semi-volatile chemicals, inorganics, pesticides & PCB's. "No Data" is indicated by "--".

**TABLE II-1
MINIMUM* LEVELS – VOLATILE CHEMICALS**

Volatile Chemicals	CAS Number	Minimum* Level (µg/L)	
		GC Method ^a	GCMS Method ^b
Acrolein	107028	2.	5
Acrylonitrile	107131	2.	2
Benzene	71432	0.5	2
Bromoform	75252	0.5	2
Carbon Tetrachloride	56235	0.5	2
Chlorobenzene	108907	0.5	2
Chlorodibromomethane	124481	0.5	2
Chloroform	67663	0.5	2
1,2-Dichlorobenzene (volatile)	95501	0.5	2
1,3-Dichlorobenzene (volatile)	541731	0.5	2
1,4-Dichlorobenzene (volatile)	106467	0.5	2
Dichlorobromomethane	75274	0.5	2
1,1-Dichloroethane	75343	0.5	1
1,2-Dichloroethane	107062	0.5	2
1,1-Dichloroethylene	75354	0.5	2
Dichloromethane	75092	0.5	2
1,3-Dichloropropene (volatile)	542756	0.5	2
Ethyl benzene	100414	0.5	2
Methyl Bromide	74839	1.	2
Methyl Chloride	74873	0.5	2
1,1,2,2-Tetrachloroethane	79345	0.5	2
Tetrachloroethylene	127184	0.5	2
Toluene	108883	0.5	2
1,1,1-Trichloroethane	71556	0.5	2
1,1,2-Trichloroethane	79005	0.5	2
Trichloroethylene	79016	0.5	2
Vinyl Chloride	75014	0.5	2

Table II-1 Notes

a) GC Method = Gas Chromatography

b) GCMS Method = Gas Chromatography / Mass Spectrometry

* To determine the lowest standard concentration in an instrument calibration curve for these techniques, use the given ML (see Chapter III, "Use of Minimum* Levels").

* See Appendix I for definition of terms.

TABLE II-2
MINIMUM* LEVELS – SEMI VOLATILE CHEMICALS

Semi-Volatile Chemicals	CAS Number	Minimum* Level (µg/L)			
		GC Method ^{a,*}	GCMS Method ^{b,*}	HPLC Method ^{c,*}	COLOR Method ^d
Acenaphthylene	208968	--	10	0.2	--
Anthracene	120127	--	10	2	--
Benidine	92875	--	5	--	--
Benzo(a)anthracene	56553	--	10	2	--
Benzo(a)pyrene	50328	--	10	2	--
Benzo(b)fluoranthene	205992	--	10	10	--
Benzo(g,h,i)perylene	191242	--	5	0.1	--
Benzo(k)fluoranthene	207089	--	10	2	--
Bis 2-(1-Chloroethoxy) methane	111911	--	5	--	--
Bis(2-Chloroethyl)ether	111444	10	1	--	--
Bis(2-Chloroisopropyl)ether	39638329	10	2	--	--
Bis(2-Ethylhexyl) phthalate	117817	10	5	--	--
2-Chlorophenol	95578	2	5	--	--
Chrysene	218019	--	10	5	--
Di-n-butyl phthalate	84742	--	10	--	--
Dibenzo(a,h)anthracene	53703	--	10	0.1	--
1,2-Dichlorobenzene (semivolatile)	95504	2	2	--	--
1,3-Dichlorobenzene (semivolatile)	541731	2	1	--	--
1,4-Dichlorobenzene (semivolatile)	106467	2	1	--	--
3,3-Dichlorobenzidine	91941	--	5	--	--
2,4-Dichlorophenol	120832	1	5	--	--
1,3-Dichloropropene	542756	--	5	--	--
Diethyl phthalate	84662	10	2	--	--
Dimethyl phthalate	131113	10	2	--	--
2,4-Dimethylphenol	105679	1	2	--	--
2,4-Dinitrophenol	51285	5	5	--	--
2,4-Dinitrotoluene	121142	10	5	--	--
1,2-Diphenylhydrazine	122667	--	1	--	--
Fluoranthene	206440	10	1	0.05	--
Fluorene	86737	--	10	0.1	--
Hexachlorobenzene	118741	5	1	--	--
Hexachlorobutadiene	87683	5	1	--	--
Hexachlorocyclopentadiene	77474	5	5	--	--

Table II-2 continued on next page...

* See Appendix I for definition of terms.

Table II-2 (Continued)
Minimum* Levels – Semi Volatile Chemicals

Semi-Volatile Chemicals	CAS Number	Minimum* Level (µg/L)			
		GC Method ^{a, *}	GCMS Method ^{b, *}	HPLC Method ^{c, *}	COLOR Method ^d
Hexachloroethane	67721	5	1	--	--
Indeno(1,2,3-cd)pyrene	193395	--	10	0.05	--
Isophorone	78591	10	1	--	--
2-methyl-4,6-dinitrophenol	534521	10	5	--	--
3-methyl-4-chlorophenol	59507	5	1	--	--
N-nitrosodi-n-propylamine	621647	10	5	--	--
N-nitrosodimethylamine	62759	10	5	--	--
N-nitrosodiphenylamine	86306	10	1	--	--
Nitrobenzene	98953	10	1	--	--
2-Nitrophenol	88755	--	10	--	--
4-Nitrophenol	100027	5	10	--	--
Pentachlorophenol	87865	1	5	--	--
Phenanthrene	85018	--	5	0.05	--
Phenol	108952	1	1	--	50
Pyrene	129000	--	10	0.05	--
2,4,6-Trichlorophenol	88062	10	10	--	--

Table II-2 Notes:

- a) GC Method = Gas Chromatography
- b) GCMS Method = Gas Chromatography / Mass Spectrometry
- c) HPLC Method = High Pressure Liquid Chromatography
- d) COLOR Method= Colorimetric

* To determine the lowest standard concentration in an instrument calibration curve for this technique, multiply the given ML by 1000 (see Chapter III, "Use of Minimum* Levels").

* See Appendix I for definition of terms.

**TABLE II-3
MINIMUM* LEVELS - INORGANICS**

Inorganic Substances	CAS Number	Minimum* Level (µg/L)								
		COLOR Method ^a	DCP Method ^b	FAA Method ^c	GFAA Method ^d	HYDRIDE Method ^e	ICP Method ^f	ICPMS Method ^g	SPGFAA Method ^h	CVAA Method ⁱ
Antimony	7440360	--	1000.	10.	5.	0.5	50.	0.5	5.	--
Arsenic	7440382	20.	1000.	--	2.	1.	10.	2.	2.	--
Beryllium	7440417	--	1000.	20.	0.5	--	2.	0.5	1.	--
Cadmium	7440439	--	1000.	10.	0.5	--	10.	0.2	0.5	--
Chromium (total)	--	--	1000.	50.	2.	--	10.	0.5	1.	--
Chromium (VI)	18540299	10.	--	5.	--	--	--	--	--	--
Copper	7440508	--	1000.	20.	5.	--	10.	0.5	2.	--
Cyanide	57125	5.	--	--	--	--	--	--	--	--
Lead	7439921	--	10000.	20.	5.	--	5.	0.5	2.	--
Mercury	7439976	--	--	--	--	--	--	0.5	--	0.2
Nickel	7440020	--	1000.	50.	5.	--	20.	1.	5.	--
Selenium	7782492	--	1000.	--	5.	1.	10.	2.	5.	--
Silver	7440224	--	1000.	10.	1.	--	10.	0.2	2.	--
Thallium	7440280	--	1000.	10.	2.	--	10.	1.	5.	--
Zinc	7440666	--	1000.	20.	--	--	20.	1.	10.	--

Table II-3 Notes

- a) COLOR Method = Colorimetric
- b) DCP Method = Direct Current Plasma
- c) FAA Method = Flame Atomic Absorption
- d) GFAA Method = Graphite Furnace Atomic Absorption
- e) HYDRIDE Method = Gaseous Hydride Atomic Absorption
- f) ICP Method = Inductively Coupled Plasma
- g) ICPMS Method = Inductively Coupled Plasma / Mass Spectrometry
- h) SPGFAA Method = Stabilized Platform Graphite Furnace Atomic Absorption (i.e., US EPA 200.9)
- i) CVAA Method = Cold Vapor Atomic Absorption

* To determine the lowest standard concentration in an instrument calibration curve for these techniques, use the given ML (see Chapter III, "Use of Minimum* Levels").

* See Appendix I for definition of terms.

**TABLE II-4
MINIMUM* LEVELS – PESTICIDES AND PCBs***

Pesticides – PCB's	CAS Number	Minimum* Level (µg/L)
		GC Method ^{a,*}
Aldrin	309002	0.005
Chlordane	57749	0.1
4,4'-DDD	72548	0.05
4,4'-DDE	72559	0.05
4,4'-DDT	50293	0.01
Dieldrin	60571	0.01
a-Endosulfan	959988	0.02
b-Endosulfan	33213659	0.01
Endosulfan Sulfate	1031078	0.05
Endrin	72208	0.01
Heptachlor	76448	0.01
Heptachlor Epoxide	1024573	0.01
a-Hexachlorocyclohexane	319846	0.01
b-Hexachlorocyclohexane	319857	0.005
d-Hexachlorocyclohexane	319868	0.005
g-Hexachlorocyclohexane (Lindane)	58899	0.02
PCB 1016	--	0.5
PCB 1221	--	0.5
PCB 1232	--	0.5
PCB 1242	--	0.5
PCB 1248	--	0.5
PCB 1254	--	0.5
PCB 1260	--	0.5
Toxaphene	8001352	0.5

Table II-4 Notes

a) GC Method = Gas Chromatography

* To determine the lowest standard concentration in an instrument calibration curve for this technique, multiply the given ML by 100 (see Chapter III, "Use of Minimum* Levels").

* See Appendix I for definition of terms.

APPENDIX III

STANDARD MONITORING PROCEDURES

1. INTRODUCTION

The purpose of this appendix is to provide guidance to the Regional Water Boards on implementing the Ocean Plan and to ensure the reporting of useful information. Monitoring should be question driven rather than just gathering data and should be focused on assuring compliance with narrative and numeric water quality standards, the status and attainment of beneficial uses, and identifying sources of pollution.

It is not feasible to prescribe requirements in the Ocean Plan that encompass all circumstances and conditions that could be encountered by all dischargers, nor is it desirable to limit the flexibility of the Regional Water Boards in the monitoring of ocean waters. This appendix should therefore be considered the basic framework for the design of an ocean discharger monitoring program. The Regional Water Boards are responsible for issuing monitoring and reporting programs (MRPs) that will implement this monitoring guidance. Regional Water Boards can deviate from the procedures required in the appendix only with the approval of the State Water Resources Control Board.

This monitoring guidance utilizes a model monitoring framework. The model monitoring framework has three components that comprise a range of spatial and temporal scales: (1) core monitoring, (2) regional monitoring, and (3) special studies.

1) Core monitoring consists of the basic site-specific monitoring necessary to measure compliance with individual effluent limits and/or impacts to receiving water* quality. Core monitoring is typically conducted in the immediate vicinity of the discharge by examining local scale spatial effects.

2) Regional monitoring provides information necessary to make assessments over large areas and serves to evaluate cumulative effects of all anthropogenic inputs. Regional monitoring data also assists in the interpretation of core monitoring studies. It is recommended that the Regional Water Boards require participation by the discharger in an approved regional monitoring program, if available, for the receiving water*. In the event that a regional monitoring effort takes place during a permit cycle in which the MRP does not specifically address regional monitoring, a Regional Water Board may allow relief from aspects of core monitoring components in order to encourage participation.

3) Special studies are directed monitoring efforts designed in response to specific management or research questions identified through either core or regional monitoring programs. Often they are used to help understand core or regional monitoring results, where a specific environmental process is not well understood, or to address unique issues of local importance. Regional Water Boards may require special studies as appropriate. Special studies are not addressed further in this guidance because they are beyond its scope.

The Ocean Plan does not address all site-specific monitoring issues and allows the Regional Water Boards to select alternative protocols with the approval of the State Water Board. If no

* See Appendix I for definition of terms.

direction is given in this appendix for a specific provision of the Ocean Plan, it is within the discretion of the Regional Water Boards to establish the monitoring requirements for that provision.

2. QUALITY ASSURANCE

All receiving and ambient water monitoring conducted in compliance with MRPs must be comparable with the Quality Assurance requirements of the Surface Water Ambient Monitoring Program (SWAMP).

SWAMP comparable means all sample collection and analyses shall meet or exceed the measurement quality objectives (MQOs) – including all sample types, frequencies, control limits and holding time requirements – as specified in the SWAMP Quality Assurance Project Plan (QAPrP)

The SWAMP QAPrP is located at:

http://www.waterboards.ca.gov/water_issues/programs/swamp/tools.shtml#qa.

For those measurements that do not have SWAMP MQOs available, then MQOs shall be at the discretion of the Regional Water Board. Refer to the USEPA guidance document (EPA QA/G-4) for selecting data quality objectives, located at <http://www.epa.gov/quality/qs-docs/g4-final.pdf>.

Water Quality data must be reported according to the California Environmental Data Exchange Network (CEDEN) “Data Template” format for all constituents that are monitored in receiving and ambient water. CEDEN Data Template are available at: <http://ceden.org>.

3. TYPE OF WASTE DISCHARGE SOURCES

Discharges to ocean waters are highly diverse and variable, exhibiting a wide range of constituents, effluent quality and quantity, location and frequency of discharge. Different types of discharges will require different approaches. This Appendix provides specific direction for three broad types of discharges: (1) Point Sources, (2) Storm Water Point Sources and (3) Non-point Sources.

3.1. Point Sources

Industrial, municipal, marine laboratory and other traditional point sources of pollution that discharge wastewater directly to surface waters and are required to obtain NPDES permits.

3.2. Storm Water Point Sources

Storm Water Point Sources, hereafter referred to as Storm Water Sources, are those NPDES permitted discharges regulated by Construction or Industrial Storm Water General Permits or municipal separate storm sewer system (MS4s) Permits. MS4 Permits are further divided into Phase I and II Permits. A Phase I MS4 Permit is issued by a Regional Water Board for medium (serving between 100,000 and 250,000 people) and large (serving 250,000 or more people) municipalities. A Phase II MS4 General Permit is issued by the State Water Resources Control Board for the discharge of storm water for smaller municipalities, and includes nontraditional

* See Appendix I for definition of terms.

Small MS4s, which are governmental facilities such as military bases, public campuses, prison and hospital complexes.

3.3. Non-point Sources

A Non-point Source is any source of pollutants that is not a Point Source described in Section 3.1 or a Storm Water Source as described in Section 3.2. Land use categories contributing to non-point sources include but are not limited to:

- a. Agriculture
- b. Grazing
- c. Forestry/timber harvest
- d. Urban not covered under an NPDES permit
- e. Marinas and mooring fields
- f. Golf Courses not covered under an NPDES Permit

Only agricultural and golf course related non-point source discharge monitoring is addressed in this Appendix, but Regional Water Boards may issue MRPs for other non-point sources at their discretion. Agriculture includes irrigated lands. Irrigated lands are where water is applied for the purpose of producing crops, including, but not limited to, row and field crop, orchards, vineyard, rice production, nurseries, irrigated pastures, and managed wetlands.

4. INDICATOR BACTERIA*

4.1. Point Sources

Primary questions to be addressed:

1. Does the effluent comply with the water quality standards in the receiving water*?
2. Does the sewage effluent reach water contact zones or commercial shellfish beds?

To answer these questions, core monitoring shall be conducted in receiving water* on the shoreline for the indicator bacteria* at a minimum weekly for any point sources discharging treated sewage effluent:

- a. within one nautical mile of shore, or
- b. within one nautical mile of a commercial shellfish bed, or
- c. if the discharge is in excess of 10 million gallons per day (MGD).

Alternatively, these requirements may be met through participation in a regional monitoring program to assess the status of marine contact recreation water quality. If the permittee participates in a regional monitoring program, in conjunction with local health organization(s), core monitoring may be suspended for that period at the discretion of the Regional Water Board. Regional monitoring should be used to answer the above questions, and may be used to answer additional questions. These additional questions may include, but are not limited to, questions regarding the extent and magnitude of current or potential receiving water* indicator bacteria* problems, or the sources of indicator bacteria.

4.2. Storm Water

* See Appendix I for definition of terms.

Primary questions to be addressed:

1. Does the receiving water* comply with water quality standards?
2. Is the condition of the receiving water* protective of contact recreation and shellfish harvesting beneficial uses?
3. Are the indicator bacteria levels in receiving water* getting better or worse?
4. What is the relative contribution of indicator bacteria to the receiving water* from storm water runoff?

To answer these questions, core monitoring for indicator bacteria* shall be required periodically for storm water discharges representative of the area of concern. At a minimum, for municipal storm water discharges, all receiving water* at outfalls greater than 36 inches in diameter or width must be monitored (ankle depth, point zero) at the following frequencies:

- a. During wet weather with a minimum of three storms per year, and
- b. When non-storm water discharges* occur (flowing during dry weather), and if located at an AB 411 beach, at least weekly. (An AB 411 Beach is defined as a beach visited by more than 50,000 people annually and located on an area adjacent to a storm drain that flows in the summer. (Health & Saf. Code § 115880.)).

Regional Water Boards may waive monitoring once structural best management practices have been installed, evaluated and determined to have successfully controlled indicator bacteria.

Alternatively, these requirements may be met through participation in a regional monitoring program to assess the status of marine contact recreation water quality. If the permittee participates in a regional monitoring program, in conjunction with local health organization(s), core monitoring may be suspended for that period at the discretion of the Regional Water Board. Regional monitoring should be used to answer the above questions, and may be used to answer additional questions. These additional questions may include, but are not limited to, questions regarding the extent and magnitude of current or potential receiving water* indicator bacteria problems, or the sources of indicator bacteria*.

4.3. Non-point Sources

Primary questions to be addressed:

1. Does the receiving water* comply with water quality standards?
2. Do agricultural and golf course non-point source discharges reach water contact or shellfish harvesting zones?
3. Are the indicator bacteria levels in receiving water* getting better or worse?
4. What is the relative contribution of indicator bacteria* to the receiving water* from agricultural and golf course non-point sources?

To answer these questions, core monitoring of representative agricultural irrigation tail water and storm water runoff, at a minimum, will be conducted in receiving water* (ankle depth, point zero) for indicator bacteria:

- a. During wet weather, at a minimum of two storm events per year, and

* See Appendix I for definition of terms.

- b. When non-storm water discharges* occur (flowing during dry weather), and if located at an AB 411 beach or within one nautical mile of shellfish bed, at least weekly.

Alternatively, these requirements may be met through participation in a regional monitoring program to assess the status of marine contact recreation water quality. If the discharger participates in a regional monitoring program, in conjunction with local health organization(s), core monitoring may be suspended for that period at the discretion of the Regional Water Board. Regional monitoring should be used to answer the above questions, and may be used to answer additional questions. These additional questions may include, but are not limited to, questions regarding the extent and magnitude of current or potential receiving water* indicator bacteria problems, or the sources of indicator bacteria*.

5. CHEMICAL CONSTITUENTS

5.1. Point Sources

Primary questions addressed:

1. Does the effluent meet permit effluent limits thereby ensuring that water quality standards are achieved in the receiving water*?
2. What is the mass of the constituents that are discharged annually?
3. Is the effluent concentration or mass changing over time?

Consistent with Appendix VI, the core monitoring for the substances in Table 1 and Table 2 shall be required periodically. For discharges less than 10 MGD, the monitoring frequency shall be at least one complete scan of the Table 1 substances annually. Discharges greater than 10 MGD shall be required to monitor at least semiannually.

5.2. Storm Water

Primary questions addressed:

1. Does the receiving water* meet the water quality standards?
2. Are the conditions in receiving water* getting better or worse?
3. What is the relative runoff contribution to pollution in the receiving water*?

For Phase I and Phase II MS4 dischargers, core receiving water* monitoring will be required at a minimum for 10 percent of all outfalls greater than 36 inches in diameter or width once per year. If a discharger has less than five outfalls exceeding 36 inches in diameter or width, they shall conduct monitoring at a minimum of only once per outfall during a five year period. Monitoring shall be for total suspended solids, oil & grease, total organic carbon, pH, temperature, biochemical oxygen demand, turbidity, Table 1 metals, PAHs*, and pesticides determined by the Regional Water Boards. Regional Water Boards may waive monitoring once structural best management practices have been installed, evaluated and determined to have successfully controlled pollutants.

For industrial storm water discharges, runoff monitoring must be conducted at all outfalls at least two storm events per year. In addition, at least one representative receiving water* sample must be collected per industrial storm water permittee during two storm events per year.

* See Appendix I for definition of terms.

Monitoring shall be conducted for total suspended solids, oil & grease, total organic carbon, pH, temperature, biochemical oxygen demand, turbidity, and Table 1 metals and PAHs*.

The requirements for individual core monitoring for Table 1 metals, PAHs* and pesticides may be waived at the discretion of the Regional Water Board, if the permittee participates in a regional program for monitoring runoff and/or receiving water* to answer the above questions as well as additional questions. Additional questions may include, but are not limited to, questions regarding the extent and magnitude of current or potential receiving water* problems from storm water runoff, or sources of any runoff pollutants.

5.3. Non-point Sources

The primary questions are:

1. Does the agricultural or golf course runoff meet water quality standards in the receiving water*?
2. Are nutrients present that would contribute to objectionable aquatic algal blooms or degrade indigenous biota?
3. Are the conditions in receiving water* getting better or worse?
4. What is the relative agricultural runoff or golf course contribution to pollution in the receiving water*?

To answer these questions, a statistically representative sample (determined by the Regional Water Board) of receiving water at the sites of agricultural irrigation tail water and storm water runoff, and golf course runoff in each watershed will be monitored for Ocean Plan Table 1 metals, ammonia as N, nitrate as N, phosphate as P, and pesticides determined by the Regional Board:

- a. During wet weather, at a minimum of two storm events per year, and
- b. During dry weather, when flowing, at a frequency determined by the Regional Boards.

This requirement may be satisfied by core monitoring individually, or through participation in a regional program for monitoring runoff and receiving water* at the discretion of the Regional Water Board to answer the above questions as well as additional questions. Additional questions may include, but are not limited to, questions regarding the sources of agricultural pollutants.

6. SEDIMENT MONITORING

All Sources:

1. Is the dissolved sulfide concentration of waters in sediments significantly increased above that present under natural conditions?
2. Is the concentration of substances set forth in Table 1, for protection of marine aquatic life, in marine sediments at levels which would degrade the benthic community?
3. Is the concentration of organic pollutants in marine sediments at levels that would degrade the benthic community?

6.1. Point Sources

* See Appendix I for definition of terms.

For discharges greater than 10 MGD, acid volatile sulfides, OP Pesticides, Table 1 metals, ammonia N, PAHs*, and chlorinated hydrocarbons will be measured in sediments annually in a core monitoring program approved by the Regional Water Board. Sediment sample locations will be determined by the Regional Water Board. If sufficient data exists from previous water column monitoring for these parameters, the Regional Water Board at its discretion may reduce the frequency of monitoring, or may allow this requirement to be satisfied through participation in a regional monitoring program.

6.2. Storm Water

For Phase I MS4 permittees, discharges greater than 72 inches in diameter or width discharging to low energy coastal environments with the likelihood of sediment deposition, acid volatile sulfides, OP Pesticides, Ocean Plan Table 1 metals, ammonia N, PAHs*, and chlorinated hydrocarbons will be measured in sediments once per permit cycle.

Regional Water Boards may waive monitoring once structural best management practices have been installed, evaluated and determined to have successfully controlled pollutants.

This requirement may be satisfied by core monitoring individually or through participation in a regional monitoring program at the discretion of the Regional Water Board. Sediment sample locations will be determined by the Regional Water Board.

7. AQUATIC LIFE TOXICITY

Toxicity tests are another method used to assess risk to aquatic life. These tests assess the overall toxicity of the effluent, including the toxicity of unmeasured constituents and/or synergistic effects of multiple constituents.

7.1. Point Sources

1. Does the effluent meet permit effluent limits for toxicity thereby ensuring that water quality standards are achieved in the receiving water*?
2. If not:
 - a. Are unmeasured pollutants causing risk to aquatic life?
 - b. Are pollutants in combinations causing risk to aquatic life?

Core monitoring for Table 1 effluent toxicity shall be required periodically. For discharges less than 0.1 MGD the monitoring frequency for acute and/or chronic toxicity shall be twice per permit cycle. For discharges between 0.1 and 10 MGD, the monitoring frequency for acute and/or chronic toxicity of the effluent should be at least annually. For discharges greater than 10 MGD, the monitoring frequency for acute and/or chronic toxicity of the effluent should be at least semiannually.

For discharges greater than 10 MGD in a low energy coastal environment with the likelihood of sediment deposition, Core monitoring for acute sediment toxicity is required and will utilize alternative amphipod species (*Eohaustorius estuarius*, *Leptocheirus plumulosus*, *Rhepoxynius abronius*).

* See Appendix I for definition of terms.

If an exceedance is detected, six additional toxicity tests are required within a 12-week period. If an additional exceedance is detected within the 12-week period, a toxicity reduction evaluation (TRE) is required, consistent with Section III.C.10. which requires a TRE if a discharge consistently exceeds an effluent limitation based on a toxicity objective in Table 1.

7.2. Storm Water

1. Does the runoff meet objectives for toxicity in the receiving water*?
2. Are the conditions in receiving water* getting better or worse with regard to toxicity?
3. What is the relative runoff contribution to the receiving water* toxicity?
4. What are the causes of the toxicity and the sources of the constituents responsible?

For Phase I MS4, Phase II MS4, and industrial storm water discharges, core toxicity monitoring will be required at a minimum for 10 percent of all outfalls greater than 36 inches in diameter or width at a minimum of once per year. Receiving water* monitoring shall be for Table 1 critical life stage chronic toxicity for a minimum of one invertebrate species.

For storm water discharges greater than 72 inches in diameter or width in a low energy coastal environment with the likelihood of sediment deposition, core sediment monitoring for acute sediment toxicity is required and will utilize alternative amphipod species (*Eohaustorius estuarius*, *Leptocheirus plumulosus*, *Rhepoxynius abronius*).

Regional Water Boards may waive monitoring once structural best management practices have been installed, evaluated and determined to have successfully controlled toxicity.

If an exceedance is detected, an additional toxicity test is required during the subsequent storm event. If an additional exceedance is detected at that time, a TRE is required, consistent with Section III.C.10. which requires a TRE if a discharge consistently exceeds an effluent limitation based on a toxicity objective in Table 1. A sufficient volume must be collected to conduct a TIE, if necessary, as a part of a TRE.

The requirement for core toxicity monitoring may be waived at the discretion of the Regional Water Board, if the permittee participates in a regional monitoring program to answer the above questions, as well as any other additional questions that may be developed by the regional monitoring program.

7.3. Non-point Sources

1. Does the agricultural and golf course runoff meet water quality standards for toxicity in the receiving water*?
2. Are the conditions in receiving water* getting better or worse with regard to toxicity?
3. What is the relative agricultural and golf course runoff contribution to receiving water* toxicity?
4. What are the causes of the toxicity, and the sources of the constituents responsible?

To answer these questions, a statistically representative sample (determined by the Regional Water Board) of receiving water* at the sites of agricultural irrigation tail water and storm water runoff, and golf course runoff, in each watershed will be monitored:

* See Appendix I for definition of terms.

- a. During wet weather, at a minimum of two storm events per year, and
- b. During dry weather, when flowing, at a frequency determined by the Regional Boards.

Core receiving water* monitoring shall include Table 1 critical life stage chronic toxicity for a minimum of one invertebrate species.

For runoff in a low energy coastal environment with the likelihood of sediment deposition, core sediment monitoring shall include acute sediment toxicity utilizing alternative amphipod species (*Eohaustorius estuarius*, *Leptocheirus plumulosus*, *Rhepoxynius abronius*) at a minimum once per year.

If an exceedance is detected, an additional toxicity test is required during the subsequent storm event. If an additional exceedance is detected, a TRE is required, consistent with Section III.C.10. which requires a TRE if a discharge consistently exceeds an effluent limitation based on a toxicity objective in Table 1. A sufficient volume must be collected to conduct a TIE, if necessary, as a part of a TRE.

The requirement for core monitoring may be waived at the discretion of the Regional Water Board, if the permittee participates in a regional monitoring program to answer the above questions, as well as any other additional questions that may be developed by the regional monitoring program.

8. BENTHIC COMMUNITY HEALTH

8.1. Point Sources

1. Are benthic communities degraded as a result of the discharge?

To answer this question, benthic community monitoring shall be conducted

- a. for all discharges greater than 10 MGD, or
- b. those discharges greater than 0.1 MGD and one nautical mile or less from shore, or
- c. discharges greater than 0.1 MGD and one nautical mile or less from a State Water Quality Protection Area or a State Marine Reserve.

The minimum frequency shall be once per permit cycle, except for discharges greater than 100 MGD the minimum frequency shall be at least twice per permit cycle.

This requirement may be satisfied by core monitoring individually or through participation in a regional monitoring program at the discretion of the Regional Board.

9. BIOACCUMULATION

9.1. Point Sources

1. Does the concentration of pollutants in fish, shellfish*, or other marine resources used for human consumption bioaccumulate to levels that are harmful to human health?
2. Does the concentration of pollutants in marine life bioaccumulate to levels that degrade marine communities?

* See Appendix I for definition of terms.

To answer these questions, bioaccumulation monitoring shall be conducted, at a minimum, once per permit cycle for:

- a. discharges greater than 10 MGD, or
- b. those discharges greater than 0.1 MGD and one nautical mile or less from shore, or
- c. discharges greater than 0.1 MGD and one nautical mile or less from a State Water Quality Protection Area or a State Marine Reserve, Park or Conservation Area.

Constituents to be monitored must include pesticides (at the discretion of the Regional Board), Table 1 metals, and PAHs*. Bioaccumulation may be monitored by a mussel watch program or a fish tissue program. Resident mussels are preferred over transplanted mussels. Sand crabs and/or fish may be added or substituted for mussels at the discretion of the Regional Water Board.

This requirement may be satisfied individually as core monitoring or through participation in a regional monitoring program at the discretion of the Regional Water Board.

9.2. Storm Water

1. Does the concentration of pollutants in fish, shellfish*, or other marine resources used for human consumption bioaccumulate to levels that are harmful to human health?
2. Does the concentration of pollutants in marine life bioaccumulate to levels that degrade marine communities?

For Phase I MS4 dischargers, bioaccumulation monitoring shall be conducted, at a minimum, once per permit cycle. Constituents to be monitored must include OP Pesticides, Ocean Plan Table 1 metals, Table 1 PAHs*, Table 1 chlorinated hydrocarbons, and pyrethroids. Bioaccumulation may be monitored by a mussel watch program or a fish tissue program. Sand crabs, fish, and/or Solid Phase Microextraction may be added or substituted for mussels at the discretion of the Regional Water Board.

This requirement may be satisfied individually as core monitoring or through participation in a regional monitoring program at the discretion of the Regional Water Board.

10. RECEIVING WATER* CHARACTERISTICS

All Sources:

1. Is natural light significantly reduced at any point outside the zone of initial dilution as the result of the discharge of waste?
2. Does the discharge of waste cause a discoloration of the ocean surface?
3. Does the discharge of oxygen demanding waste cause the dissolved oxygen concentration to be depressed at any time more than 10 percent from that which occurs naturally, as the result of the discharge of oxygen demanding* waste materials?
4. Does the discharge of waste cause the pH to change at any time more than 0.2 units from that which occurs naturally?
5. Does the discharge of waste cause the salinity to become elevated in the receiving water*?
6. Do nutrients cause objectionable aquatic growth or degrade indigenous biota?

* See Appendix I for definition of terms.

10.1. Point Sources

For discharges greater than 10 MGD, turbidity (alternatively light transmissivity or surface water transparency), color [Chlorophyll-A and/or color dissolved organic matter (CDOM)], dissolved oxygen and pH shall be measured in the receiving water* seasonally, at a minimum, in a core monitoring program approved by the Regional Water Board. If sufficient data exists from previous water column monitoring for these parameters, the Regional Water Board, at its discretion, may reduce the frequency of water column monitoring, or may allow this requirement to be satisfied through participation in a regional monitoring program. Use of regional ocean observing programs, such as the Southern California Coastal Ocean Observing System (SCCOOS) and the Central and Northern California Ocean Observing System (CeNCCOOS) is encouraged.

Salinity must also be monitored by all point sources discharging desalination brine as part of their core monitoring program.

10.2. Storm Water

At a minimum, 10 percent of Phase I MS4 discharges greater than 36 inches, receiving water* turbidity, color, dissolved oxygen, pH, nitrate, phosphate, and ammonia shall be measured annually in a core monitoring program approved by the Regional Water Board.

Regional Water Boards may waive monitoring once structural best management practices have been installed, evaluated and determined to have successfully controlled pollutants. The Regional Water Board, at its discretion, may also allow this requirement to be satisfied through participation in a regional monitoring program.

10.3. Non-point Sources

Representative agricultural and golf course discharges shall be measured, at a minimum twice annually (during two storm season and irrigation season) for receiving water* turbidity, color, dissolved oxygen, pH, nitrate, phosphate, ammonia in a core monitoring program approved by the Regional Water Board. The Regional Water Board, at its discretion, may allow this requirement to be satisfied through participation in a regional monitoring program.

11. ANALYTICAL REQUIREMENTS

Procedures, calibration techniques, and instrument/reagent specifications shall conform to the requirements of 40 CFR PART 136. Compliance monitoring shall be determined using an US EPA approved protocol as provided in 40 CFR PART 136. All methods shall be specified in the monitoring requirement section of waste discharge requirements.

Where methods are not available in 40 CFR PART 136, the Regional Water Boards shall specify suitable analytical methods in waste discharge requirements. Acceptance of data should be predicated on demonstrated laboratory performance.

* See Appendix I for definition of terms.

Laboratories analyzing monitoring data shall be certified by the California Department of Public Health, in accordance with the provisions of Water Code section 13176, and must include quality assurance quality control data with their reports.

Sample dilutions for total and fecal coliform bacterial analyses shall range from 2 to 16,000. Sample dilutions for enterococcus bacterial analyses shall range from 1 to 10,000 per 100 mL. Each test method number or name (e.g., EPA 600/4-85/076, Test Methods for *Escherichia coli* and *Enterococci* in Water by Membrane Filter Procedure) used for each analysis shall be specified and reported with the results.

Test methods used for coliforms (total and fecal) shall be those presented in Table 1A of 40 CFR PART 136, unless alternate methods have been approved in advance by U.S. EPA pursuant to 40 CFR PART 136.

Test methods used for enterococcus shall be those presented in U.S. EPA publication EPA 600/4-85/076, Test Methods for *Escherichia coli* and *Enterococci* in Water by Membrane Filter Procedure or any improved method determined by the Regional Board to be appropriate. The Regional Water Board may allow analysis for *Escherichia coli* (*E. coli*) by approved test methods to be substituted for fecal coliforms if sufficient information exists to support comparability with approved methods and substitute the existing methods.

The State or Regional Water Board may, subject to U.S. EPA approval, specify test methods which are more sensitive than those specified in 40 CFR PART 136. Because storm water and non-point sources are not assigned a dilution factor, sufficient sampling and analysis shall be required to determine compliance with Table 1 Water Quality Objectives. Total chlorine residual is likely to be a method detection limit effluent limitation in many cases. The limit of detection of total chlorine residual in standard test methods is less than or equal to 20 µg/L.

Toxicity monitoring requirements in permits prepared by the Regional Water Boards shall use marine test species instead of freshwater species when measuring compliance. The Regional Water Board shall require the use of critical life stage toxicity tests specified in this Appendix to measure TUc. For Point Sources, a minimum of three test species with approved test protocols shall be used to measure compliance with the toxicity objective. If possible, the test species shall include a fish, an invertebrate, and an aquatic plant. After a screening period, monitoring can be reduced to the most sensitive species.

Dilution and control water should be obtained from an unaffected area of the receiving waters*. The sensitivity of the test organisms to a reference toxicant shall be determined concurrently with each bioassay test and reported with the test results.

Use of critical life stage bioassay testing shall be included in waste discharge requirements as a monitoring requirement for all Point Source discharges greater than 100 MGD

Procedures and methods used to determine compliance with benthic monitoring should use the following federal guidelines when applicable: Macroinvertebrate Field and Laboratory Methods for Evaluating the Biological Integrity of Surface Waters (1990) -- EPA/600/4-90/030 (PB91-171363). This manual describes guidelines and standardized procedures for the use of macroinvertebrates in evaluating the biological integrity of surface waters.

* See Appendix I for definition of terms.

Procedures used to determine compliance with bioaccumulation monitoring should use the U.S. EPA. Guidance for Assessing Chemical Contaminant Data for Use in Fish Advisories (November 2000, EPA 823-B-00-007), NOAA Technical Memorandum NOS ORCA 130, Sampling and Analytical Methods of the National Status and Trends Program Mussel Watch Project (1998 update), and/or State Mussel Watch Program, 1987-1993 Data Report, State Water Resources Control Board 94-1WQ.

* See Appendix I for definition of terms.

**TABLE III-1
APPROVED TESTS – CHRONIC TOXICITY (TU_c)**

<u>Species</u>	<u>Effect</u>	<u>Tier</u>	<u>Reference</u>
giant kelp, <i>Macrocystis pyrifera</i>	percent germination; germ tube length	1	1,3
red abalone, <i>Haliotis rufescens</i>	Abnormal shell development	1	1,3
oyster, <i>Crassostrea gigas</i> ; mussels, <i>Mytilus spp.</i>	Abnormal shell development; percent survival	1	1,3
urchin, <i>Strongylocentrotus purpuratus</i> ; sand dollar, <i>Dendraster excentricus</i>	Percent normal development	1	1,3
urchin, <i>Strongylocentrotus purpuratus</i> ; sand dollar, <i>Dendraster excentricus</i>	Percent fertilization	1	1,3
shrimp, <i>Holmesimysis costata</i>	Percent survival; growth	1	1,3
shrimp, <i>Mysidopsis bahia</i>	Percent survival; growth; fecundity	2	2,4
topsmelt, <i>Atherinops affinis</i>	Larval growth rate; percent survival	1	1,3
Silversides, <i>Menidia beryllina</i>	Larval growth rate; percent survival	2	2,4

Table III-1 Notes

The first tier test methods are the preferred toxicity tests for compliance monitoring. A Regional Water Board can approve the use of a second tier test method for waste discharges if first tier organisms are not available.

* See Appendix I for definition of terms.

Protocol References

1. Chapman, G.A., D.L. Denton, and J.M. Lazorchak. 1995. Short-term methods for estimating the chronic toxicity of effluents and receiving waters to west coast marine and estuarine organisms. U.S. EPA Report No. EPA/600/R-95/136.
2. Klemm, D.J., G.E. Morrison, T.J. Norberg-King, W.J. Peltier, and M.A. Heber. 1994. Short-term methods for estimating the chronic toxicity of effluents and receiving water to marine and estuarine organisms. U.S. EPA Report No. EPA-600-4-91-003.
3. SWRCB 1996. Procedures Manual for Conducting Toxicity Tests Developed by the Marine Bioassay Project. 96-1WQ.
4. Weber, C.I., W.B. Horning, I.I., D.J. Klemm, T.W. Nieheisel, P.A. Lewis, E.L. Robinson, J. Menkedick and F. Kessler (eds). 1988. Short-term Methods for Estimating the Chronic Toxicity of Effluents and Receiving Waters to Marine and Estuarine Organisms. EPA/600/4-87/028. National Information Service, Springfield, VA.

* See Appendix I for definition of terms.

**APPENDIX IV
PROCEDURES FOR THE NOMINATION AND DESIGNATION OF
STATE WATER QUALITY PROTECTION AREAS*.**

1. Any person may nominate areas of ocean waters for designation as SWQPA-ASBS or SWQPA-GP by the State Water Board. Nominations shall be made to the appropriate Regional Water Board and shall include:
 - (a) Information such as maps, reports, data, statements, and photographs to show that:
 - (1) Candidate areas are located in ocean waters as defined in the "Ocean Plan".
 - (2) Candidate areas are intrinsically valuable or have recognized value to man for scientific study, commercial use, recreational use, or esthetic reasons.
 - (3) Candidate areas need protection beyond that offered by waste discharge restrictions or other administrative and statutory mechanisms.
 - (b) Data and information to indicate whether the proposed designation may have a significant effect on the environment.
 - (1) If the data or information indicate that the proposed designation will have a significant effect on the environment, the nominee must submit sufficient information and data to identify feasible changes in the designation that will mitigate or avoid the significant environmental effects.
2. The State Water Board or a Regional Water Board may also nominate areas for designation as SWQPA-ASBS or SWQPA-GP on their own motion.
3. A Regional Water Board may decide to (a) consider individual SWQPA-ASBS or SWQPA-GP nominations upon receipt, (b) consider several nominations in a consolidated proceeding, or (c) consider nominations in the triennial review of its water quality control plan (basin plan). A nomination that meets the requirements of 1. above may be considered at any time but not later than the next scheduled triennial review of the appropriate basin plan or Ocean Plan.
4. After determining that a nomination meets the requirements of paragraph 1. above, the Executive Officer of the affected Regional Water Board shall prepare a Draft Nomination Report containing the following:
 - (a) The area or areas nominated for designation as SWQPA-ASBS or SWQPA-GP.
 - (b) A description of each area including a map delineating the boundaries of each proposed area.
 - (c) A recommendation for action on the nomination(s) and the rationale for the recommendation. If the Draft Nomination Report recommends approval of the proposed designation, the Draft Nomination Report shall comply with the CEQA

* See Appendix I for definition of terms.

documentation requirements for a water quality control plan amendment in Section 3777, Title 23, California Code of Regulations.

5. The Executive Officer shall, at a minimum, seek informal comment on the Draft Nomination Report from the State Water Board, Department of Fish and Game, other interested state and federal agencies, conservation groups, affected waste dischargers, and other interested parties. Upon incorporation of responses from the consulted agencies, the Draft Nomination Report shall become the Final Nomination Report.
6.
 - (a) If the Final Nomination Report recommends approval of the proposed designation, the Executive Officer shall ensure that processing of the nomination complies with the CEQA consultation requirements in Section 3778, Title 23, California Code of Regulations and proceed to step 7 below.
 - (b) If the Final Nomination Report recommends against approval of the proposed designation, the Executive Officer shall notify interested parties of the decision. No further action need be taken. The nominating party may seek reconsideration of the decision by the Regional Water Board itself.
7. The Regional Water Board shall conduct a public hearing to receive testimony on the proposed designation. Notice of the hearing shall be published three times in a newspaper of general circulation in the vicinity of the proposed area or areas and shall be distributed to all known interested parties 45 days in advance of the hearing. The notice shall describe the location, boundaries, and extent of the area or areas under consideration, as well as proposed restrictions on waste discharges within the area.
8. The Regional Water Board shall respond to comments as required in Section 3779, Title 23, California Code of Regulations, and 40 C.F.R. Part 25 (July 1, 1999).
9. The Regional Water Board shall consider the nomination after completing the required public review processes required by CEQA.
 - (a) If the Regional Water Board supports the recommendation for designation, the board shall forward to the State Water Board its recommendation for approving designation of the proposed area or areas and the supporting rationale. The Regional Water Board submittal shall include a copy of the staff report, hearing transcript, comments, and responses to comments.
 - (b) If the Regional Water Board does not support the recommendation for designation, the Executive Officer shall notify interested parties of the decision, and no further action need be taken.
10. After considering the Regional Water Board recommendation and hearing record, the State Water Board may approve or deny the recommendation, refer the matter to the Regional Water Board for appropriate action, or conduct further hearing itself. If the State Water Board acts to approve a recommended designation, the State Water Board shall amend Appendix V, Table V-1, of this Plan. The amendment will go into effect after approval by the Office of Administrative Law and US EPA. In addition, after the effective date of a

* See Appendix I for definition of terms.

designation, the affected Regional Water Board shall revise its water quality control plan in the next triennial review to include the designation.

12. The State Water Board Executive Director shall advise other agencies to whom the list of designated areas is to be provided that the basis for an SWQPA-ASBS or SWQPA-GP designation is limited to protection of marine life from waste discharges.

* See Appendix I for definition of terms.

APPENDIX V
STATE WATER QUALITY PROTECTION AREAS
AREAS OF SPECIAL BIOLOGICAL SIGNIFICANCE

TABLE V-1
STATE WATER QUALITY PROTECTION AREAS
AREAS OF SPECIAL BIOLOGICAL SIGNIFICANCE
(DESIGNATED OR APPROVED BY THE STATE WATER RESOURCES CONTROL BOARD)

No.	ASBS Name	Date Designated	State Water Board Resolution No.	Region No.
1.	Jughandle Cove	March 21, 1974,	74-28	1
2.	Del Mar Landing	March 21, 1974,	74-28	1
3.	Gerstle Cove	March 21, 1974,	74-28	1
4.	Bodega	March 21, 1974,	74-28	1
5.	Saunders Reef	March 21, 1974,	74-28	1
6.	Trinidad Head	March 21, 1974,	74-28	1
7.	King Range	March 21, 1974,	74-28	1
8.	Redwoods National Park	March 21, 1974,	74-28	1
9.	James V. Fitzgerald	March 21, 1974,	74-28	2
10.	Farallon Islands	March 21, 1974,	74-28	2
11.	Duxbury Reef	March 21, 1974,	74-28	2
12.	Point Reyes Headlands	March 21, 1974,	74-28	2
13.	Double Point	March 21, 1974,	74-28	2
14.	Bird Rock	March 21, 1974,	74-28	2
15.	Año Nuevo	March 21, 1974,	74-28	3
16.	Point Lobos	March 21, 1974,	74-28	3
17.	San Miguel, Santa Rosa, and Santa Cruz Islands	March 21, 1974,	74-28	3
18.	Julia Pfeiffer Burns	March 21, 1974,	74-28	3
19.	Pacific Grove	March 21, 1974,	74-28	3
20.	Salmon Creek Coast	March 21, 1974,	74-28	3
21.	San Nicolas Island and Begg Rock	March 21, 1974,	74-28	4
22.	Santa Barbara and Anacapa Islands	March 21, 1974,	74-28	4
23.	San Clemente Island	March 21, 1974,	74-28	4

Table V-1 Continued on next page...

* See Appendix I for definition of terms.

Table V-1 (Continued)
Areas of Special Biological Significance
(Designated or Approved by the State Water Resources Control Board)

No.	ASBS Name	Date Designated	State Water Board Resolution No.	Region No.
24.	Laguna Point to Latigo Point	March 21, 1974,	74-28	4
25.	Northwest Santa Catalina Island	March 21, 1974,	74-28	4
26.	Western Santa Catalina Island	March 21, 1974,	74-28	4
27.	Farnsworth Bank	March 21, 1974,	74-28	4
28.	Southeast Santa Catalina	March 21, 1974,	74-28	4
29.	La Jolla	March 21, 1974,	74-28	9
30.	Heisler Park	March 21, 1974,	74-28	9
31.	San Diego-Scripps	March 21, 1974,	74-28	9
32.	Robert E. Badham	April 18, 1974	74-32	8
33.	Irvine Coast	April 18, 1974	74-32	8,9
34.	Carmel Bay	June 19, 1975	75-61	3

* See Appendix I for definition of terms.

APPENDIX VI

REASONABLE POTENTIAL ANALYSIS PROCEDURE FOR DETERMINING WHICH TABLE 1 OBJECTIVES REQUIRE EFFLUENT LIMITATIONS

In determining the need for an effluent limitation, the Regional Water Board shall use all representative information to characterize the pollutant discharge using a scientifically defensible statistical method that accounts for the averaging period of the water quality objective, accounts for and captures the long-term variability of the pollutant in the effluent, accounts for limitations associated with sparse data sets, accounts for uncertainty associated with censored data sets, and (unless otherwise demonstrated) assumes a lognormal distribution of the facility-specific effluent data.

The purpose of the following procedure (see also Figure VI-1) is to provide direction to the Regional Water Boards for determining if a pollutant discharge causes, has the reasonable potential to cause, or contributes to an excursion above Table 1 water quality objectives in accordance with 40 CFR 122.44 (d)(1)(iii). The Regional Water Board may use an alternative approach for assessing reasonable potential such as an appropriate stochastic dilution model that incorporates both ambient and effluent variability. The permit fact sheet or statement of basis will document the justification or basis for the conclusions of the reasonable potential assessment. This appendix does not apply to permits or any portion of a permit where the discharge is regulated through best management practices (BMP) unless such discharge is also subject to numeric effluent limitations.

Step 1: Identify C_o , the applicable water quality objective from Table 1 for the pollutant.

Step 2: Does information about the receiving water* body or the discharge support a reasonable potential assessment (RPA) without characterizing facility-specific effluent monitoring data? If yes, go to *Step 13* to conduct an RPA based on best professional judgment (BPJ). Otherwise, proceed to *Step 3*.

Step 3: Is facility-specific effluent monitoring data available? If yes, proceed to *Step 4*. Otherwise, go to *Step 13*.

Step 4: Adjust all effluent monitoring data C_e , including censored (ND or DNQ) values to the concentration X expected after complete mixing. For Table 1 pollutants use $X = (C_e + D_m C_s) / (D_m + 1)$; for acute toxicity use $X = C_e / (0.1 D_m + 1)$; where D_m is the minimum probable initial dilution expressed as parts seawater per part wastewater and C_s is the background seawater concentration from Table G3. For ND values, C_e is replaced with "<MDL;" for DNQ values C_e is replaced with "<ML." Go to *Step 5*.

Step 5: Count the total number of samples n , the number of censored (ND or DNQ) values, c and the number of detected values, d , such that $n = c + d$.

Is any *detected* pollutant concentration after complete mixing greater than C_o ? If yes, the discharge causes an excursion of C_o ; go to *Endpoint 1*. Otherwise, proceed to *Step 6*.

* See Appendix I for definition of terms.

Step 6: Does the effluent monitoring data contain three or more detected observations ($d \geq 3$)? If yes, proceed to *Step 7* to conduct a parametric RPA. Otherwise, go to *Step 11* to conduct a nonparametric RPA.

Step 7: Conduct a parametric RPA. Assume data are lognormally distributed, unless otherwise demonstrated. Does the data consist entirely of detected values ($c/n = 0$)? If yes,

- calculate summary statistics M_L and S_L , the mean and standard deviation of the natural logarithm transformed effluent data expected after complete mixing, $\ln(X)$,
- go to *Step 9*.

Otherwise, proceed to *Step 8*.

Step 8: Is the data censored by 80% or less ($c/n \leq 0.8$)? If yes,

- calculate summary statistics M_L and S_L using the censored data analysis method of Helsel and Cohn (1988),
- go to *Step 9*.

Otherwise, go to *Step 11*.

Step 9: Calculate the UCB i.e., the one-sided, upper 95 percent confidence bound for the 95th percentile of the effluent distribution after complete mixing. For lognormal distributions, use $UCBL_{(.95,.95)} = \exp(M_L + S_L g'_{(.95,.95,n)})$, where g' is a normal tolerance factor obtained from the table below (Table VI-1). Proceed to *Step 10*.

Step 10: Is the UCB greater than C_o ? If yes, the discharge has a reasonable potential to cause an excursion of C_o ; go to *Endpoint 1*. Otherwise, the discharge has no reasonable potential to cause an excursion of C_o ; go to *Endpoint 2*.

Step 11: Conduct a non-parametric RPA. Compare each data value X to C_o . Reduce the sample size n by 1 for each tie (i.e., inconclusive censored value result) present. An adjusted ND value having $C_o < MDL$ is a tie. An adjusted DNQ value having $C_o < ML$ is also a tie.

Step 12: Is the adjusted $n > 15$? If yes, the discharge has no reasonable potential to cause an excursion of C_o ; go to *Endpoint 2*. Otherwise, go to *Endpoint 3*.

Step 13: Conduct an RPA based on BPJ. Review all available information to determine if a water quality-based effluent limitation is required, notwithstanding the above analysis in *Steps 1* through *12*, to protect beneficial uses. Information that may be used includes: the facility type, the discharge type, solids loading analysis, lack of dilution, history of compliance problems, potential toxic impact of discharge, fish tissue residue data, water quality and beneficial uses of the receiving water*, CWA 303(d) listing for the pollutant, the presence of endangered or threatened species or critical habitat, and other information.

Is data or other information unavailable or insufficient to determine if a water quality-based effluent limitation is required? If yes, go to *Endpoint 3*. Otherwise, go to either *Endpoint 1* or *Endpoint 2* based on BPJ.

Endpoint 1: An effluent limitation must be developed for the pollutant. Effluent monitoring for the pollutant, consistent with the monitoring frequency in Appendix III, is required.

* See Appendix I for definition of terms.

Endpoint 2: An effluent limitation is not required for the pollutant. Appendix III effluent monitoring is not required for the pollutant; the Regional Board, however, may require occasional monitoring for the pollutant or for whole effluent toxicity as appropriate.

Endpoint 3: The RPA is inconclusive. Monitoring for the pollutant or whole effluent toxicity testing, consistent with the monitoring frequency in Appendix III, is required. An existing effluent limitation for the pollutant shall remain in the permit, otherwise the permit shall include a reopener clause to allow for subsequent modification of the permit to include an effluent limitation if the monitoring establishes that the discharge causes, has the reasonable potential to cause, or contributes to an excursion above a Table 1 water quality objective.

Appendix VI References:

Helsel D. R. and T. A. Cohn. 1988. Estimation of descriptive statistics for multiply censored water quality data. Water Resources Research, Vol 24(12):1977-2004.


Hahn J. H. and W. Q. Meeker. 1991. Statistical Intervals, A guide for practitioners. J. Wiley & Sons, NY.

Table VI-1: Tolerance factors $g'_{(.95,.95,n)}$ for calculating normal distribution one-sided upper 95 percent tolerance bounds for the 95th percentile (Hahn & Meeker 1991)

n	$g'_{(.95,.95,n)}$	n	$g'_{(.95,.95,n)}$
2	26.260	21	2.371
3	7.656	22	2.349
4	5.144	23	2.328
5	4.203	24	2.309
6	3.708	25	2.292
7	3.399	26	2.275
8	3.187	27	2.260
9	3.031	28	2.246
10	2.911	29	2.232
11	2.815	30	2.220
12	2.736	35	2.167
13	2.671	40	2.125
14	2.614	50	2.065
15	2.566	60	2.022
16	2.524	120	1.899
17	2.486	240	1.819
18	2.453	480	1.766
19	2.423	∞	1.645
20	2.396		

* See Appendix I for definition of terms.

Figure VI-1. Reasonable potential analysis flow chart

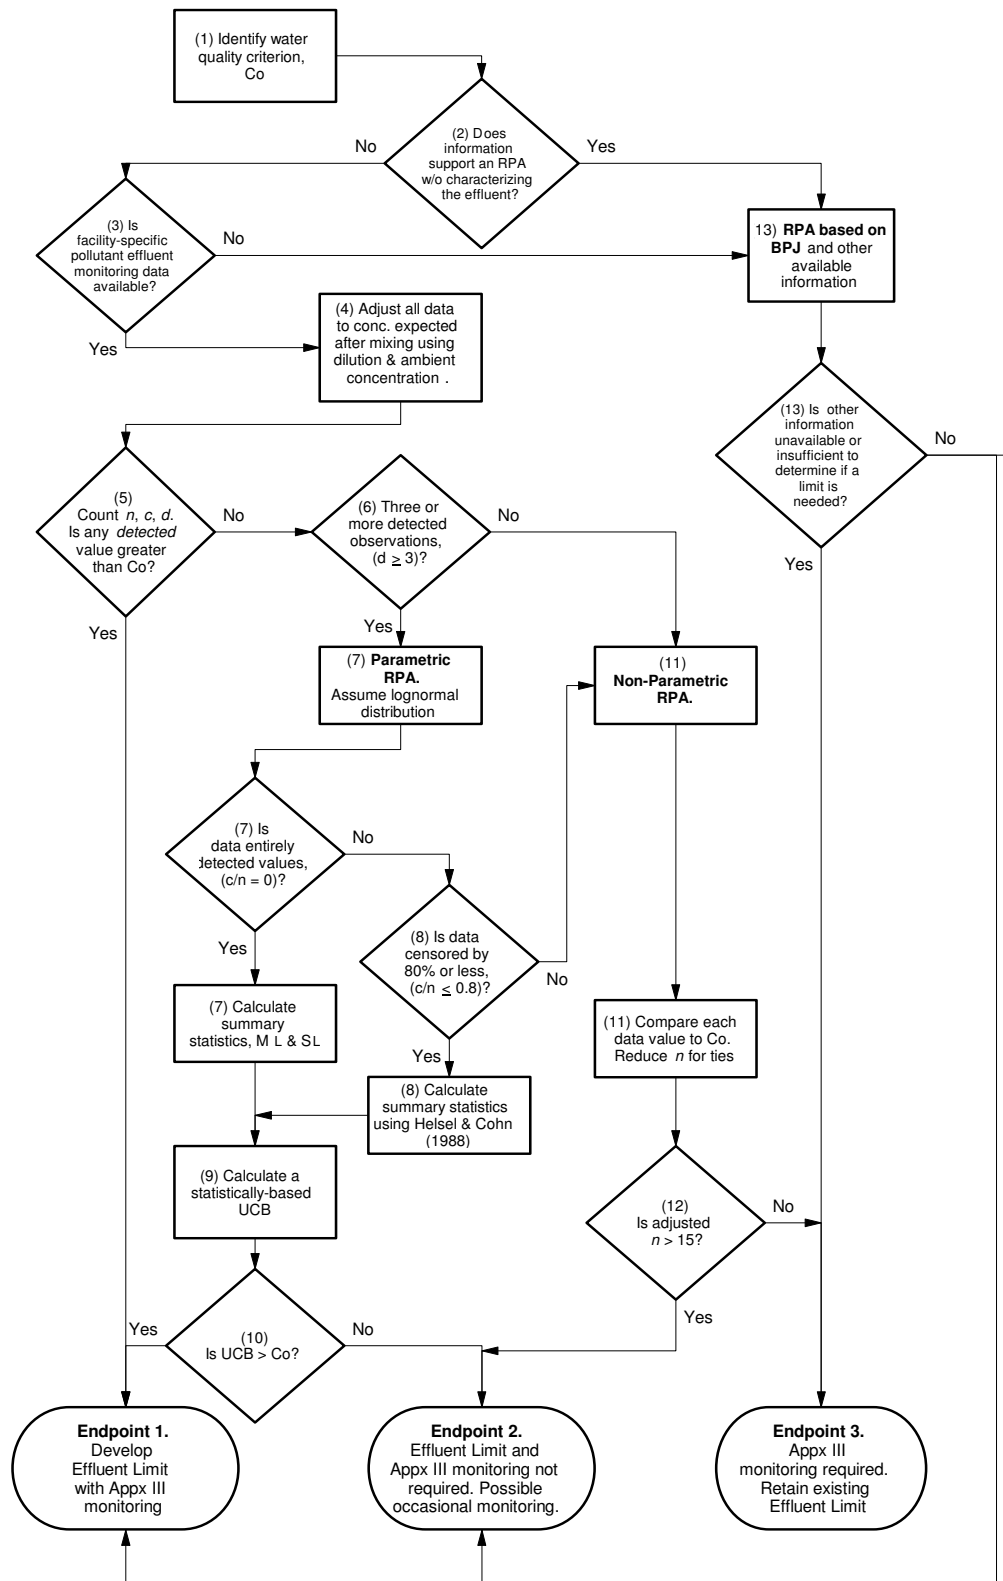

* See Appendix I for definition of terms.

APPENDIX VII
EXCEPTIONS TO THE CALIFORNIA OCEAN PLAN

TABLE VII-1
EXCEPTIONS TO THE OCEAN PLAN

(GRANTED BY THE STATE WATER RESOURCES CONTROL BOARD)

Year	Resolution	Applicable Provision	Discharger
1977	77-11	Discharge Prohibition, ASBS #23	US Navy San Clemente Island
1979	79-16	Discharge Prohibition for wet weather discharges from combined storm and wastewater collection system.	The City and County of San Francisco
1983	83-78	Discharge Prohibition, ASBS #7	Humboldt County Resort Improvement District No.1
1984	84-78	Discharge Prohibition, ASBS #34	Carmel Sanitary District
1988	88-80	Total Chlorine Residual Limitation	Haynes Power Plant Harbor Power Plant Scattergood Power Plant Alamitos Power Plant El Segundo Power Plant Long Beach Power Plant Mandalay Power Plant Ormond Beach Power Plant Redondo Power Plant
1990	90-105	Discharge Prohibition, ASBS #21	US Navy San Nicolas Island
2004	2004-0052	Discharge Prohibition, ASBS #31	UC Scripps Institution of Oceanography
2006	2006-0013	Discharge Prohibition, ASBS #25	USC Wrigley Marine Science Center
2007	2007-0058	Discharge Prohibition, ASBS #4	UC Davis Bodega Marine Laboratory
2011	2011-0049	Discharge Prohibition, ASBS #6	HSU Telonicher Marine lab
2011	2011-0050	Discharge Prohibition, ASBS #19	Monterey Bay Aquarium
2011	2011-0051	Discharge Prohibition, ASBS #19	Stanford Hopkins Marine Station
2012	2012-0012, as amended on June 19 2012; in 2012-0031	ASBS Discharge Prohibition, General Exception for Storm Water and Nonpoint Sources	27 applicants for the General Exception

* See Appendix I for definition of terms.

APPENDIX VIII MAPS OF THE OCEAN, COAST, AND ISLANDS

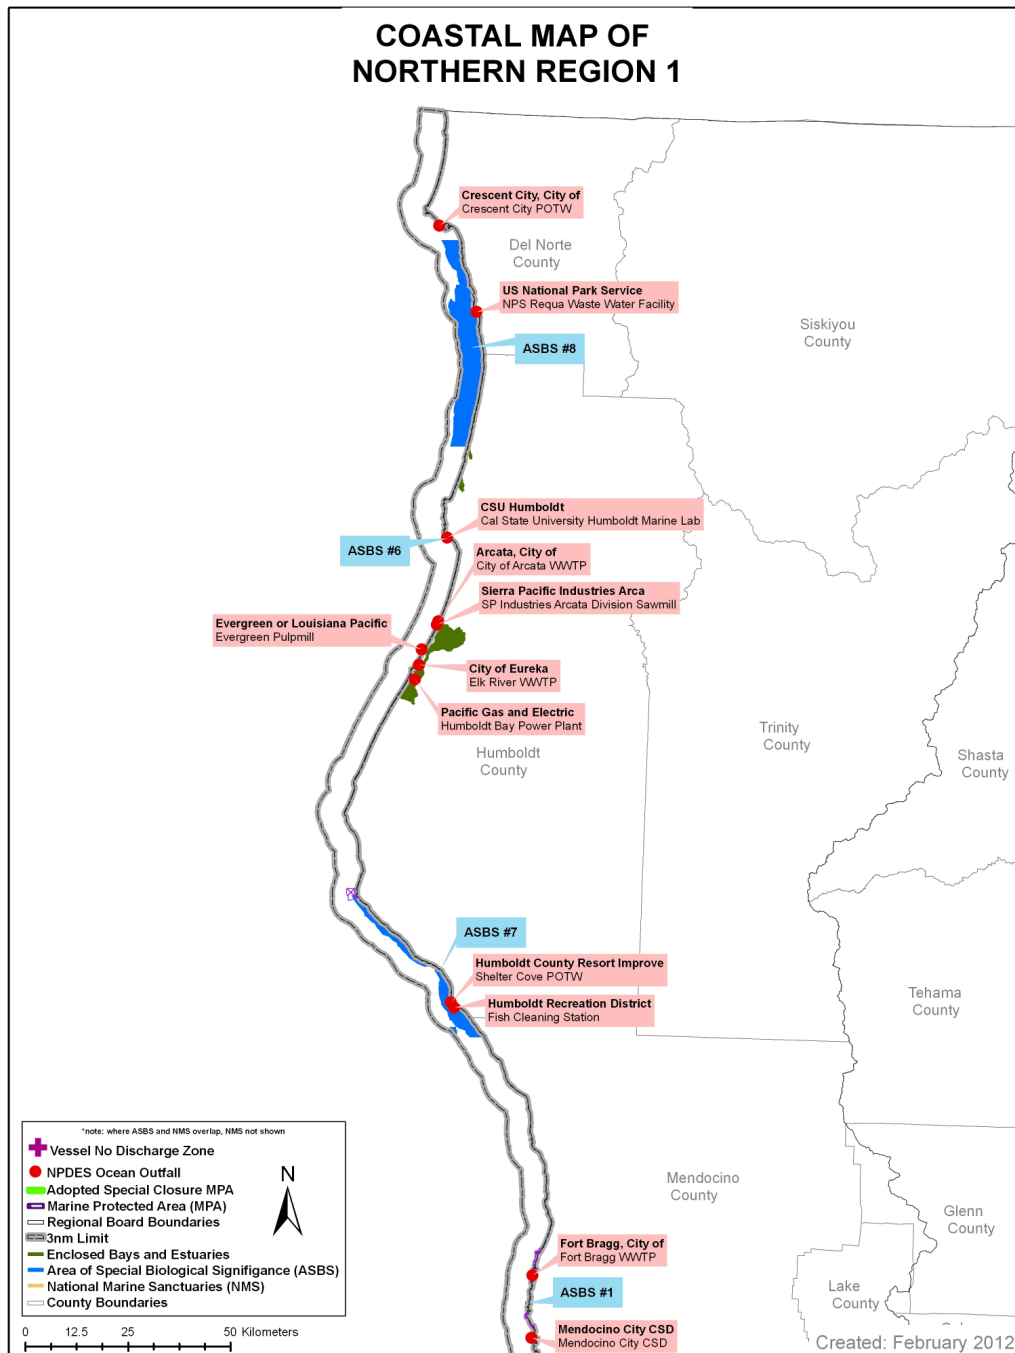


Figure VIII-1. ASBS Boundaries, MPA Boundaries, Wastewater Outfall Points, Marine Sanctuary Boundaries, and Enclosed Bays in northern Region 1.

* See Appendix I for definition of terms.

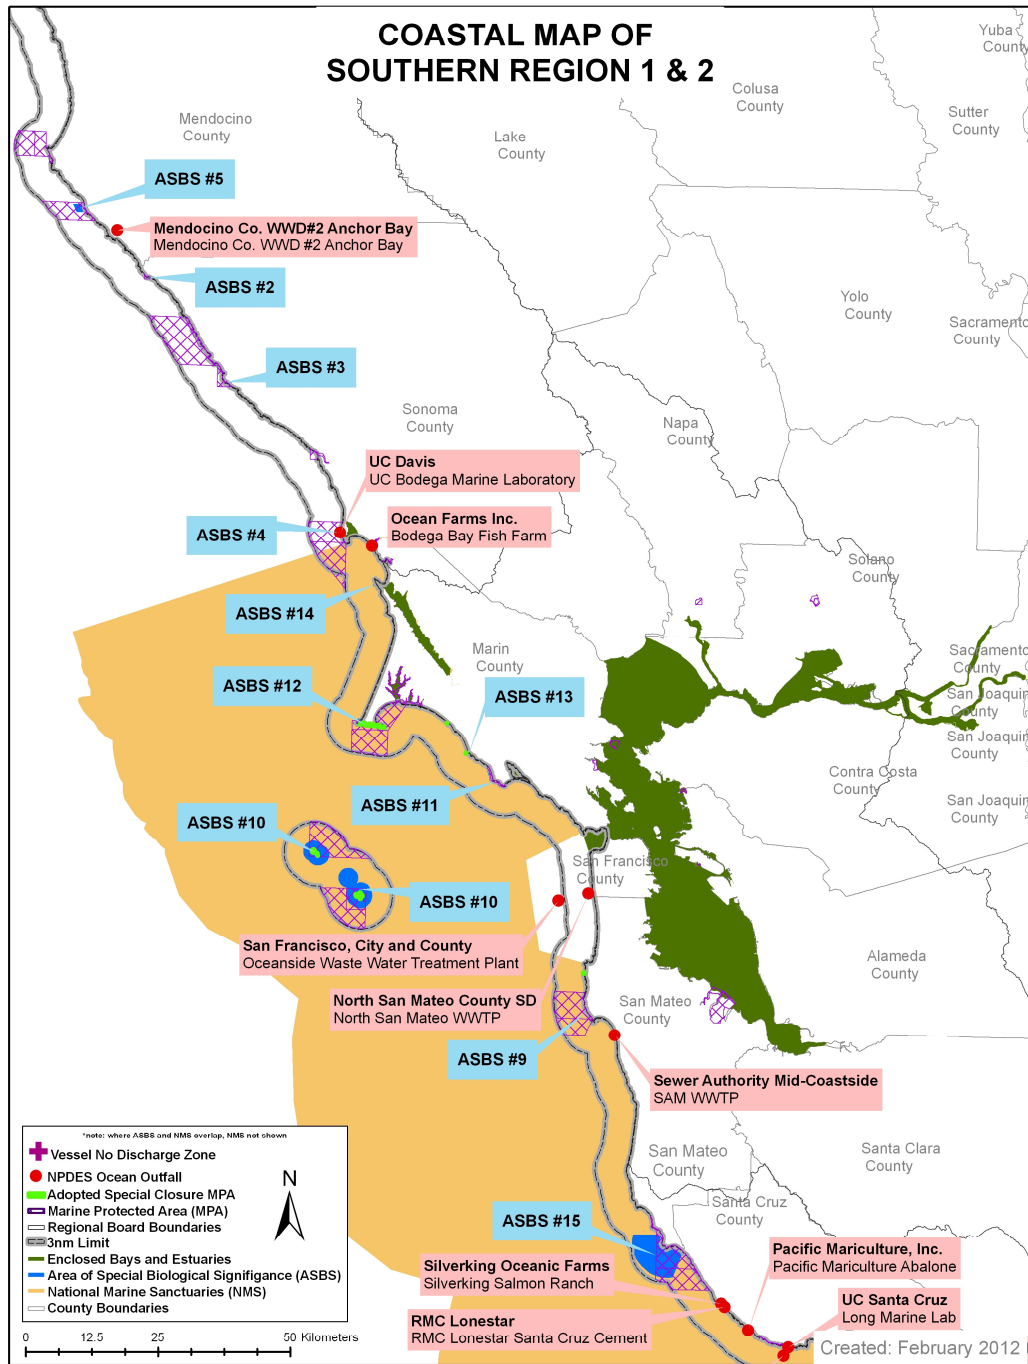


Figure VIII-2. ASBS Boundaries, MPA Boundaries, Wastewater Outfall Points, Marine Sanctuary Boundaries, and Enclosed Bays in southern Region 1 and Region 2.

* See Appendix I for definition of terms.

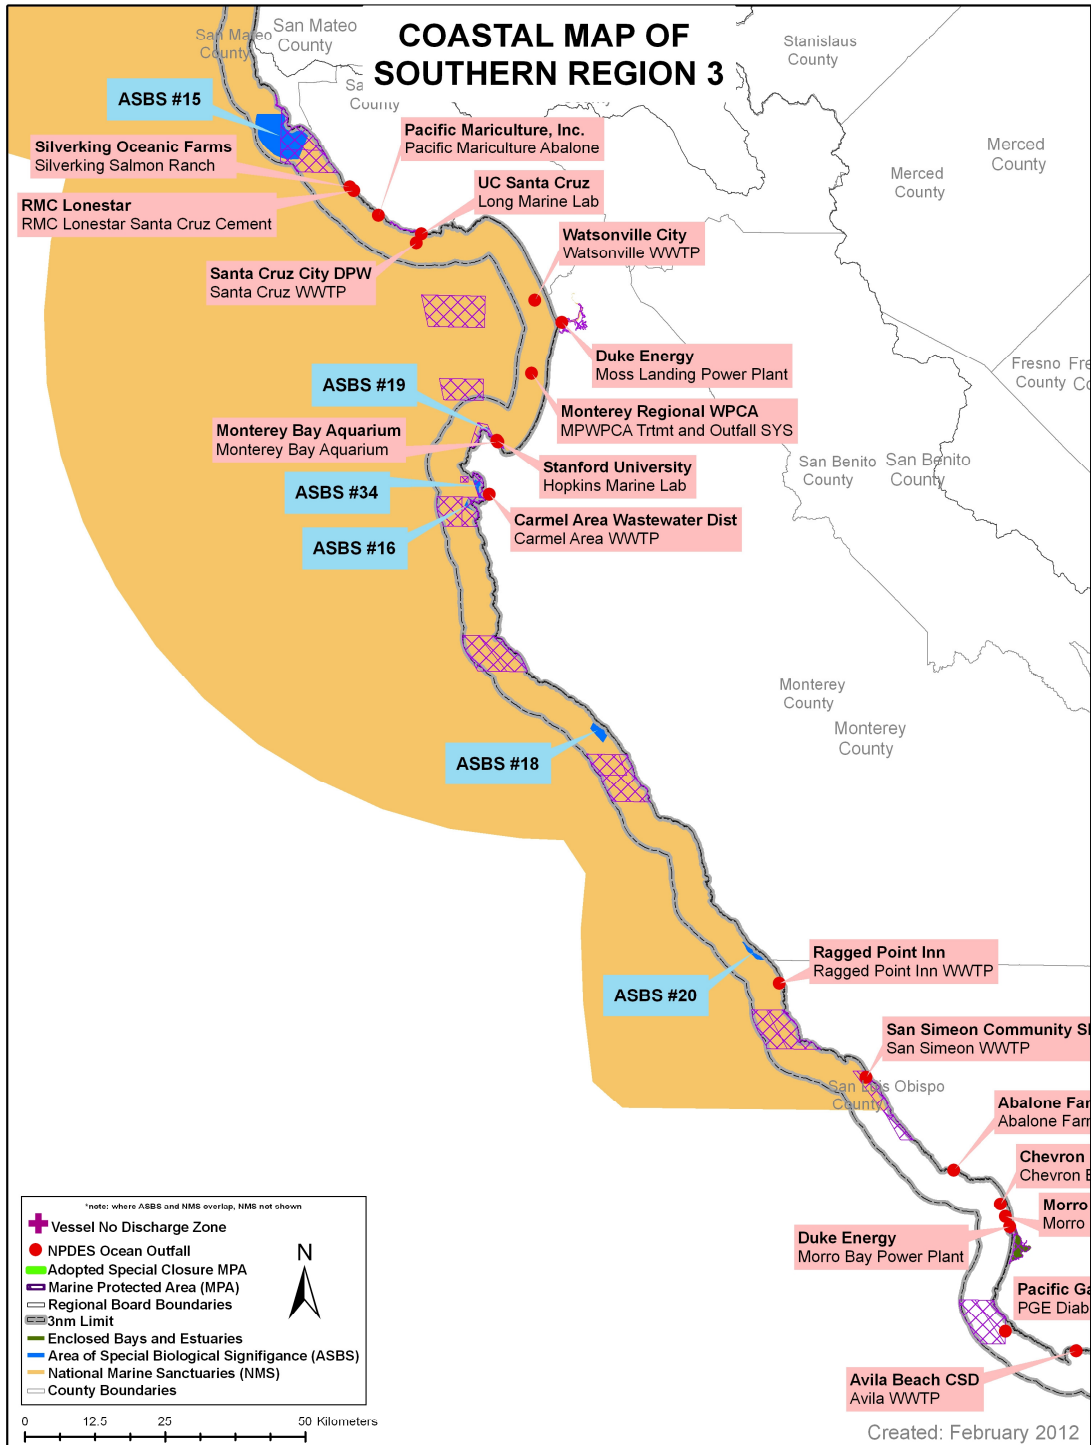


Figure VIII-3. ASBS Boundaries, MPA Boundaries, Wastewater Outfall Points, Marine Sanctuary Boundaries, and Enclosed Bays in northern Region 3.

* See Appendix I for definition of terms.

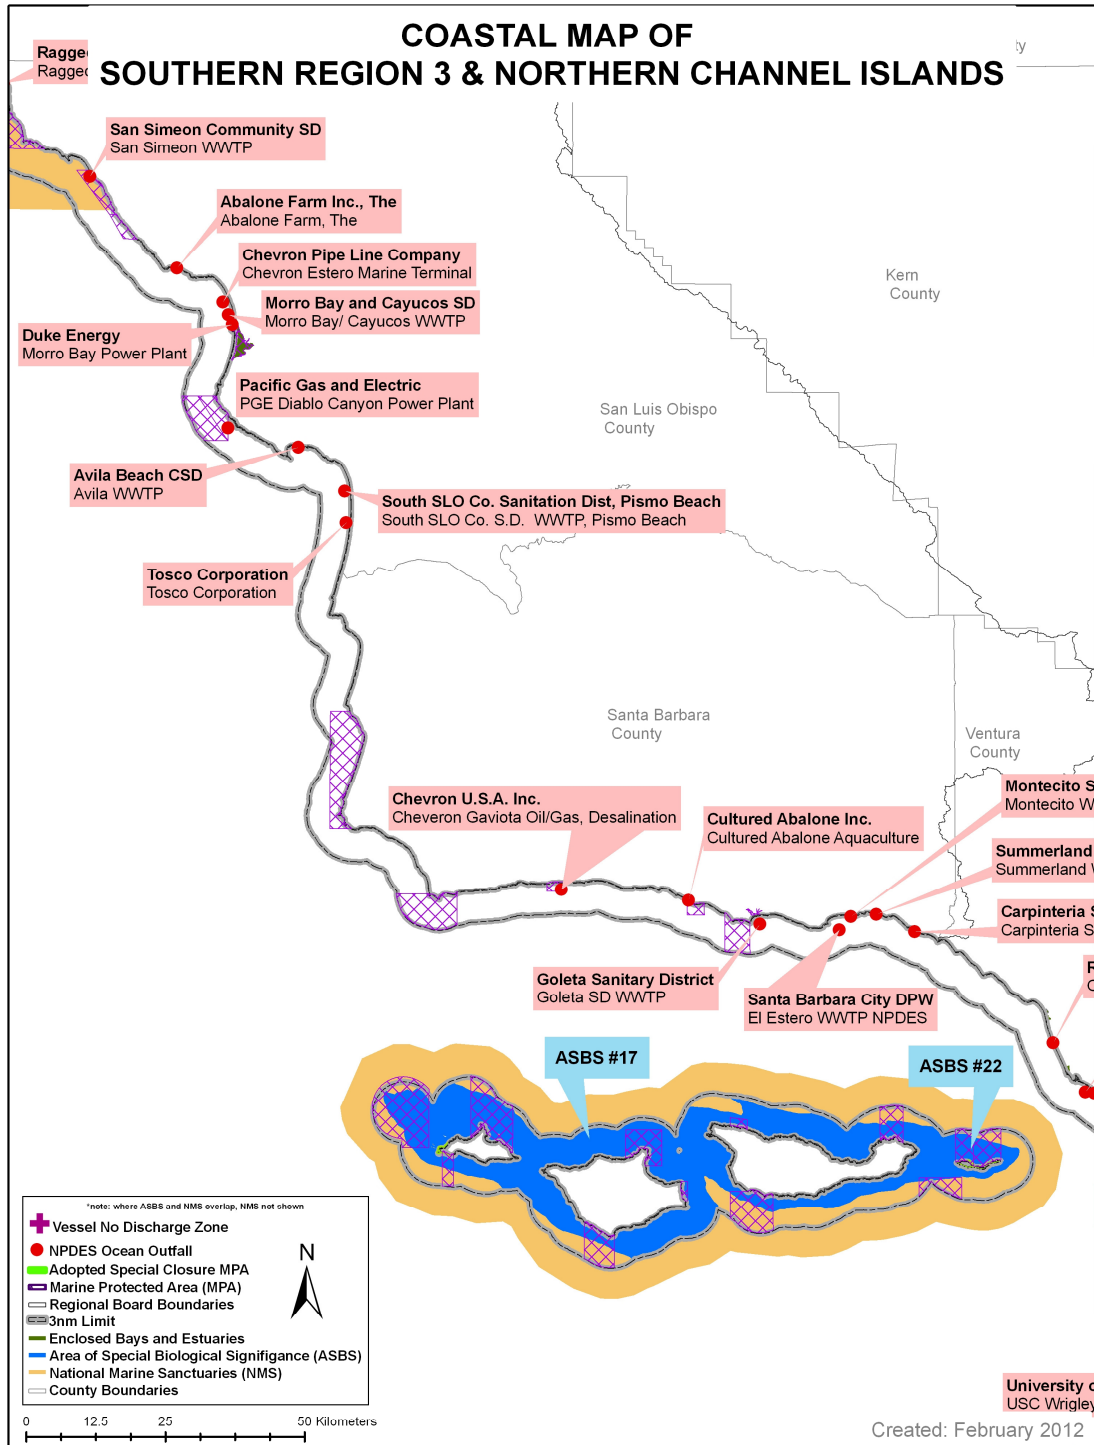


Figure VIII-4. ASBS Boundaries, MPA Boundaries, Wastewater Outfall Points, Marine Sanctuary Boundaries, and Enclosed Bays in southern Region 3 and northern Channel Islands.

* See Appendix I for definition of terms.

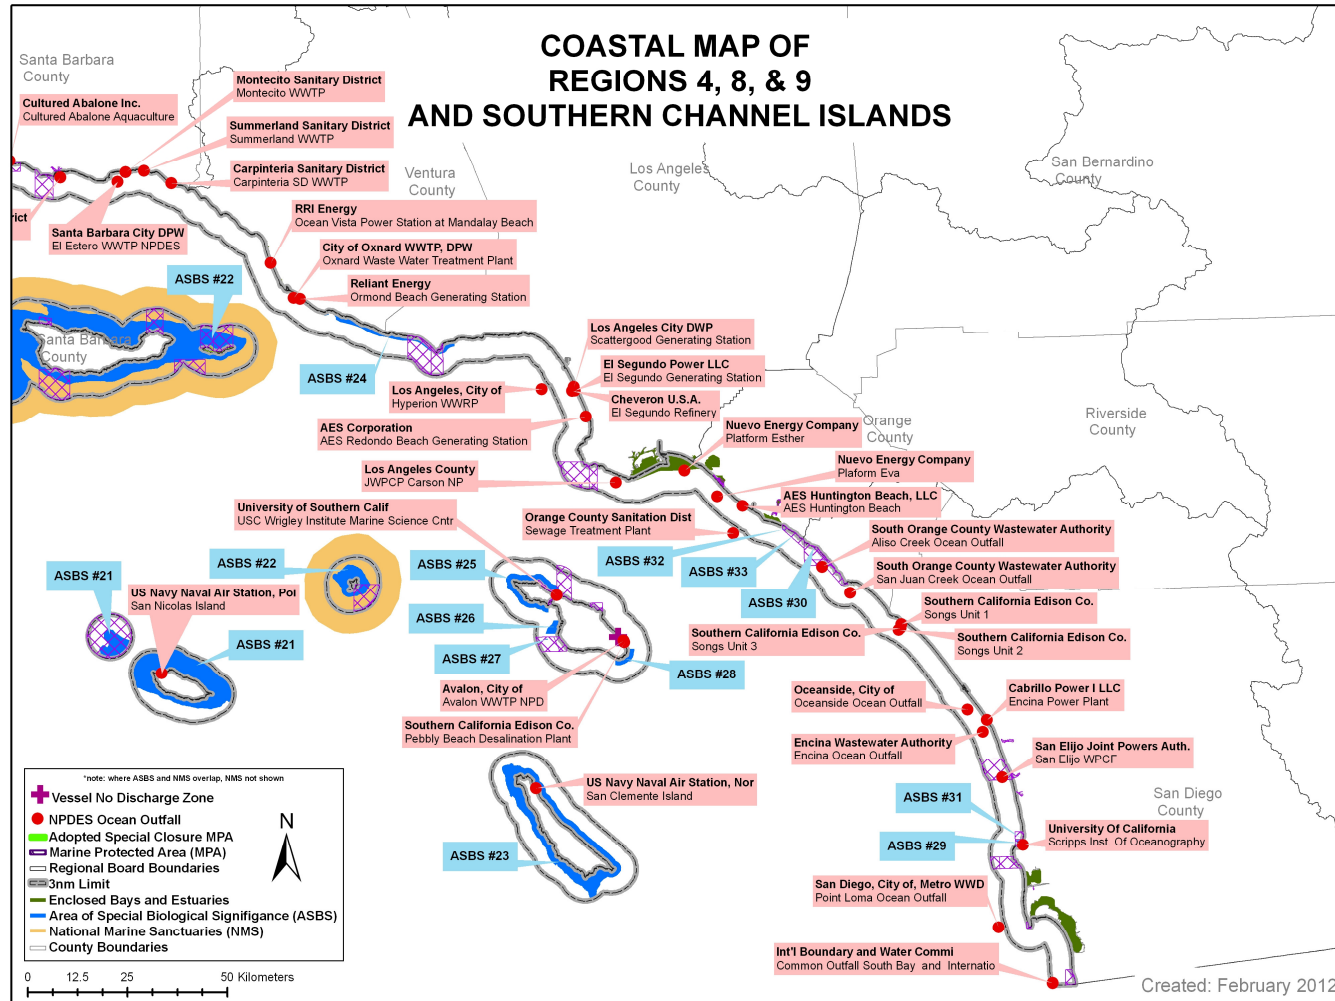


Figure VIII-5. ASBS Boundaries, MPA Boundaries, Wastewater Outfall Points, Marine Sanctuary Boundaries, and Enclosed Bays in southern Channel Islands and Regions 4, 8 and 9.

* See Appendix I for definition of terms.